
DETAILS

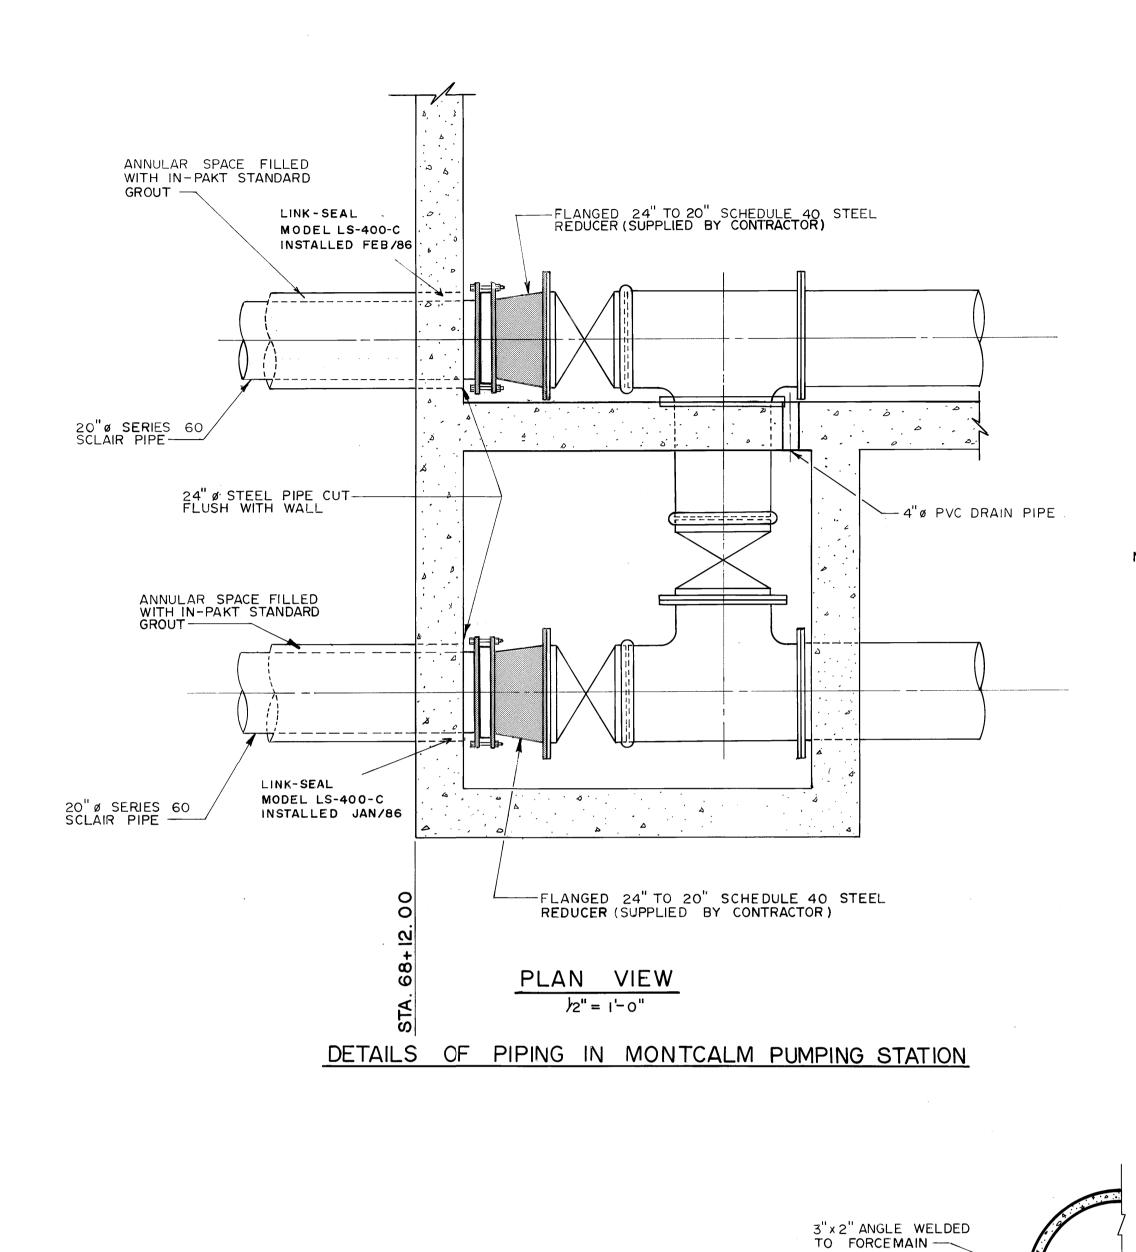


1/2"ø BOLTS, 24"c-c --

20" ø SERIES 60 SCLAIR PIPE


DETAIL A-A TYPICAL

24"ø STEEL FORCEMAIN —

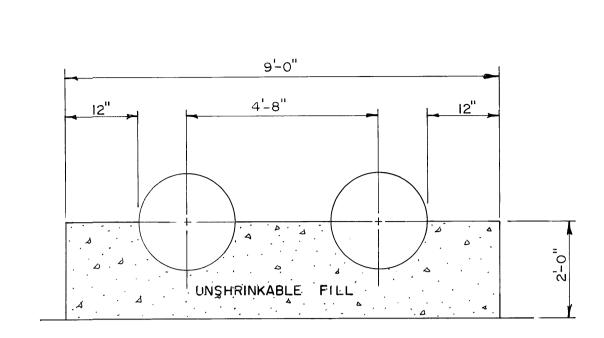

NOTE: NEW RUBBERIZED CLOTH GASKETS WERE INSTALLED BETWEEN ALL FLANGES.

BEDDING UNDER PIPE THROUGH SHAFT NOT TO SCALE

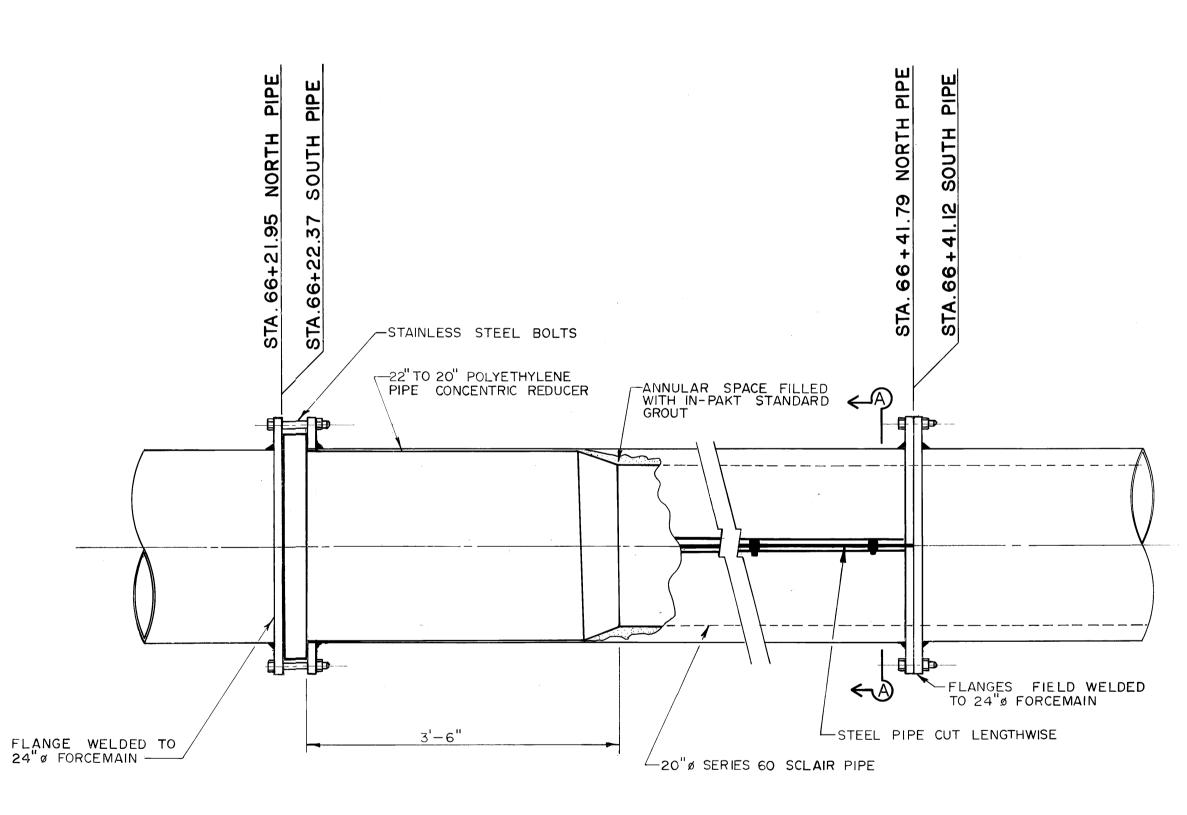

TYPICAL DETAILS OF FORCEMAIN SCALE I" = I

DESIGNED BY: DRAWN BY: R . F. CHECKED BY: MAY 3, 19**83** R.A.S. WATERWORKS WASTE & APPROVED BY: DISPOSAL DEPARTMENT 83/10/28 R.F. REVISED TO AS - BUILT DATE APP. ENGINEER'S SEAL REVISIONS

REFER ALSO TO DRAWINGS 2290 & 2620 THE CITY

0F PIPING ALTERATIONS FOR THE **WINNIPEG** MONTCALM PUMPING STATION AND FORCEMAINS **WORKS & OPERATIONS** DIVISION

> 1091 AS SHOWN