


- NOTES:**
- REFER TO SITE PLAN FOR CAMERAS MOUNTED ON EXTERIOR OF BUILDING.
 - LOCATE NEW DEVICES IN EXISTING SINGLE STALL ALONG WALL WITH DOOR (TYPICAL).
 - EXISTING WASHROOM AND STALL AREA HAS BEEN REMOUNTED. CIRCUITS SUPPLYING LIGHTS IN THIS AREA ARE UNKNOWN. INVESTIGATE CIRCUITS (SUSPECTED PANEL B IN SECOND FLOOR SOUTH MECHANICAL ROOM).
 - EXHAUST FAN DISCONNECT TO BE LOCKABLE 15A, 120V RATED CSA 1 DEVICE BOX. EXHAUST FAN TO BE CONTROLLED BY THE METASYS CONTROLLER. PROVIDE 15A, 120V RELAY IN CSA 1 ENCLOSURE IN CEILING SPACE ADJACENT TO EXHAUST FAN. PROVIDE 2 #12 AWG IN 21C FOR RELAY CONTROL FROM METASYS UNIT.
 - PROVIDE LUMINAIRE RECESSED IN CEILING OF SAUNA, RATED FOR LOCATION WITH 35W GU10, 120V DC EMERGENCY LIGHTING HEADS. CONNECT TO EMERGENCY LIGHTING SYSTEM


BATTERY BANK BB-LLG (LIBRARY LOBBY GYM)

BATTERY BANK BB-PN (POOL NORTH)

BATTERY BANK BB-LLG (LIBRARY LOBBY GYM)

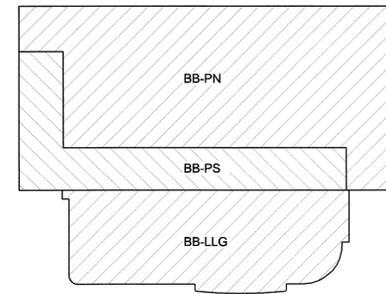

DETAIL
 SCALE: N.T.S.
 MAIN FLOOR AREA SERVED BY BATTERY BANKS



PLAN

SECURITY MANAGEMENT SYSTEM (PEGASYS) ACCESS CONTROL LOCATION SCHEDULE									
DOOR NO.	DESCRIPTION	LOCATION LEVEL	GRIDLINE	NOTES	DOOR NO.	DESCRIPTION	LOCATION LEVEL	GRIDLINE	NOTES
EXISTING DOOR LOCATIONS BEING MODIFIED					NEW DOOR LOCATIONS				
DB01E	BASEMENT DOOR FROM MAINTENANCE	BASEMENT	EA.9,E3.4.		D101A	MAIN ENTRANCE SLIDING DOUBLE DOOR	MAIN	A.7,8	3.
D101E	CARPET BOWLING SOUTH	MAIN	EJ.2,E1		D101B	MAIN ENTRANCE, SOUTH OF SLIDING DOORS	MAIN	A.9, 8	
D102E	CARPET BOWLING NORTH	MAIN	EC.5,E1		D104A	SWINGING DOOR TO LIBRARY	MAIN	B.2,4	
D103E	MAINTENANCE WEST	MAIN	EA, E1.1		D117	NETWORK ROOM 114	MAIN	A.6,2	
D104E	CHLORINE ROOM	MAIN	EA, E4.2		D118	REC CENTER STAFF ROOM	MAIN	A.5, 6,7	
D105E	SOUTH EXIT	MAIN	EA, E4.6		D209	JANITORS ROOM 209	SECOND	A.1,1.1	
D106E	EAST EXIT NORTH	MAIN	EA.7,E10		D301	DOOR TO PENTHOUSE	PENTHSE	A.4,5,6	
D107E	UNDER RAMP STORAGE	MAIN	EB.5, E9.1		D303	DOOR TO ROOF	PENTHSE	A.4,5,4	
D108E	STAFF ROOM	MAIN	EJ.6,E9		NOTES				
D109E	SOUTH STAIR TO BASEMENT/SECOND FLOOR MECHANICAL ROOM	MAIN	EJ.4,E6.8		1. ALL DOORS LISTED ABOVE REQUIRE FUNCTIONALITY AS SHOWN IN DETAIL 3/E2.7 TYPICAL SECURITY MANAGEMENT SYSTEM (PEGASYS) ACCESS CONTROL DOOR: INTERIOR AND EXTERIOR CARD READER, DOOR SENSOR, ELECTRIC STRIKE ETC.				
D110E	SOUTH POOL EXIT	MAIN	EJ,E7		2. NOT DRAWN CORRECTLY ON FLOOR PLAN, GRID LOCATION IS CORRECT.				
D111E	DATA ROOM 119	MAIN	EJ.8, E6.5		3. TWO ELECTRIC STRIKES ONLY REQUIRED				
D112E	EAST EXIT SOUTH	MAIN	EJ,E10						
D113E	EAST JANITORS ROOM	MAIN	EC,E9.6						
D114E	EAST POOL EXIT	MAIN	EB.5, E						
D115E	NORTH POOL EXIT	MAIN	EB, E5.9						
D116E	S.W. JANITORS ROOM, EAST ENTRANCE	MAIN	EJ.2, E3.4						
D117E	S.W. JANITORS ROOM, WEST ENTRANCE	MAIN	EJ.2,E3.3						
D118E	SOUTH WEST POOL EXIT	MAIN	EJ,E2						
D119E	NORTH STAIR TO BASEMENT	MAIN	EA.2, E5.4	2.					
D210E	NORTH MECHANICAL ROOM	SECOND	EA.9, E4.4						

UMA | AECOM

© 2007 UMA ENGINEERING LTD. ALL RIGHTS RESERVED.

APEGM
 Certificate of Authorization
 UMA Engineering Ltd. (MB)
 No. 256 Date: Aug 21, 2007

OC	SK	SS	SS
DRN	CHK	DES	ENG
		IDR	

UMA | AECOM REVIEW

NO.	REVISION/DESCRIPTION	BY	DATE
1	ISSUED FOR ADDENDUM #2	QL	07/08/21
0	ISSUED FOR TENDER	QL	07/07/23

SEALS

DRAWN BY: QL
 CHECKED BY: USER APPROVAL
 DATE: 2007.02.21

CITY OF WINNIPEG
 PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT
 CIVIC ACCOMMODATIONS DIVISION
 300 - 65 GARRY ST. R3C 4K4

PROJECT
Construction of Cindy Klassen Recreation Complex Facility Enhancement Project
 999 Sargent St. Winnipeg, Manitoba

SHEET TITLE
 Electrical
 Main Floor
 Life Safety and Systems

SCALE: 1:200
 PROJECT NO.: 2005-059
 SHEET NO.: **E2.8**

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1