



2 J-HOOK/WALL ENTRY DETAIL E6.2 SCALE: N.T.S.

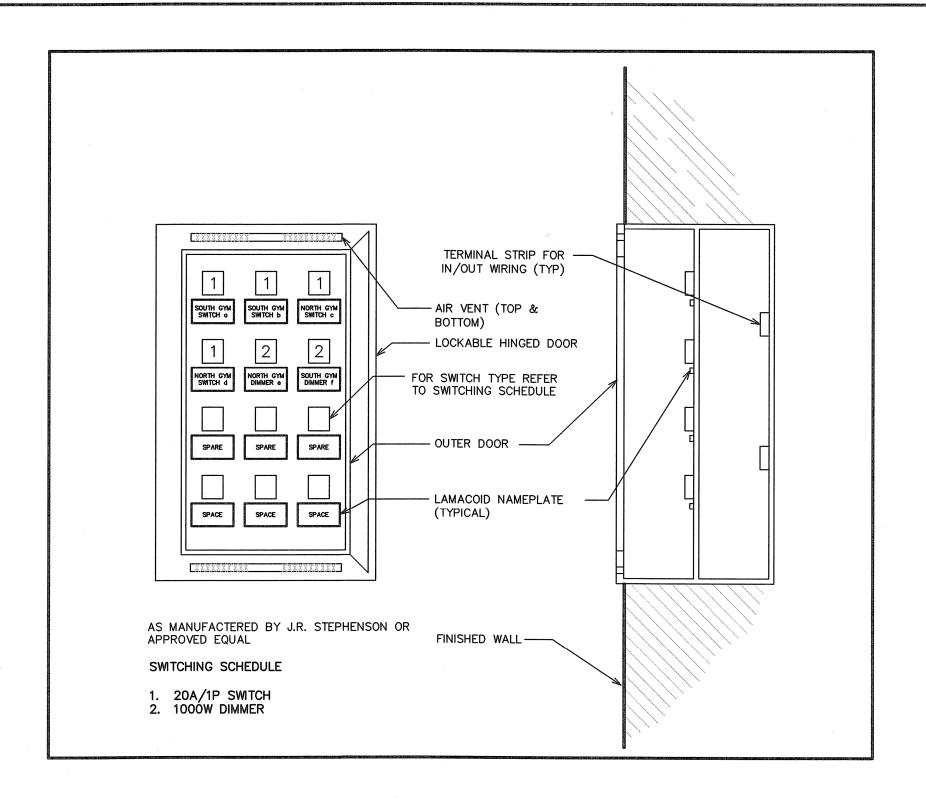


1 SWITCHING CONTROL PANEL DETAIL E6.2 SCALE: N.T.S.

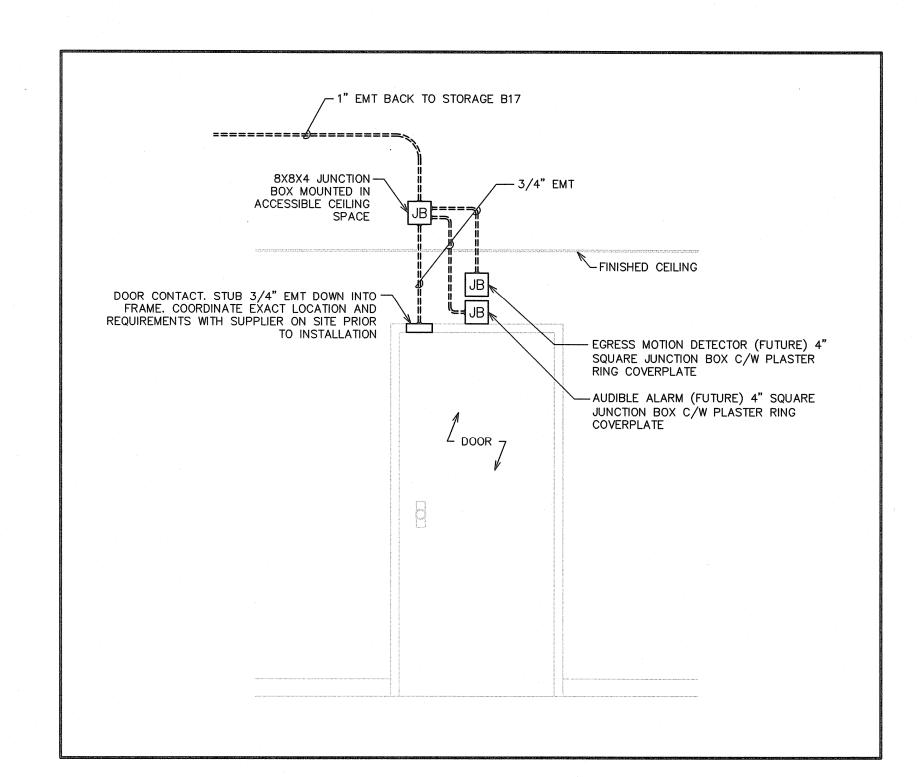


TYPICAL MONITORED DOOR DETAIL

E6.2 SCALE: N.T.S.

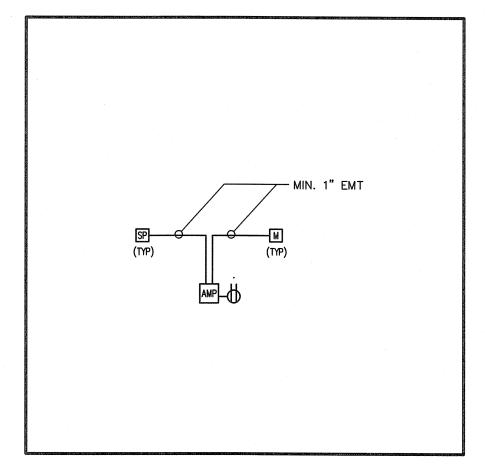


4 GYMNASIUM SOUND SYSTEM RISER DETAIL E6.2 SCALE: N.T.S.

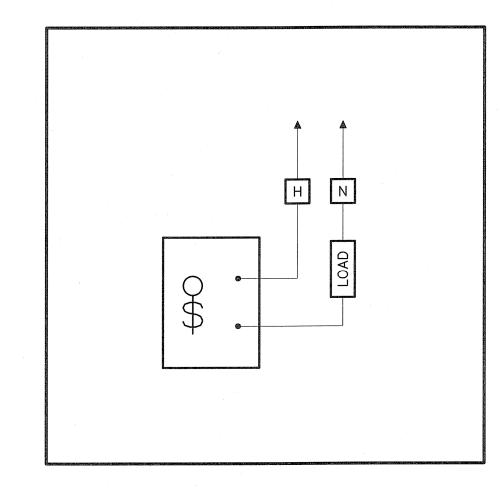

TYPICAL WALL SWITCH

SENSOR LINE DIAGRAM


E6.2 SCALE: N.T.S.

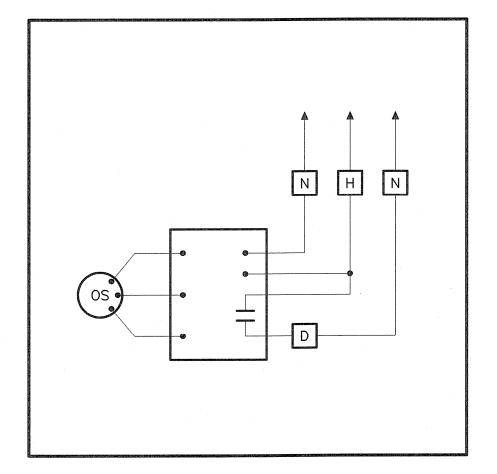

TYPICAL LOW VOLTAGE CEILING SENSOR C/W

MANUAL DIMMER INSTALLATION LINE DIAGRAM


E6.2 SCALE: N.T.S.

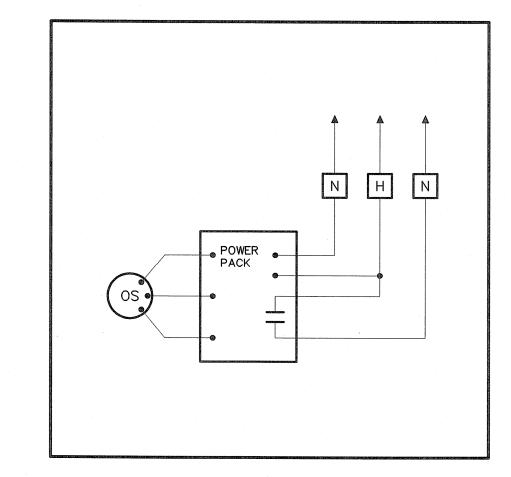

TYPICAL LOW VOLTAGE

6 CEILING SENSOR LINE DIAGRAM

E6.2 SCALE: N.T.S.

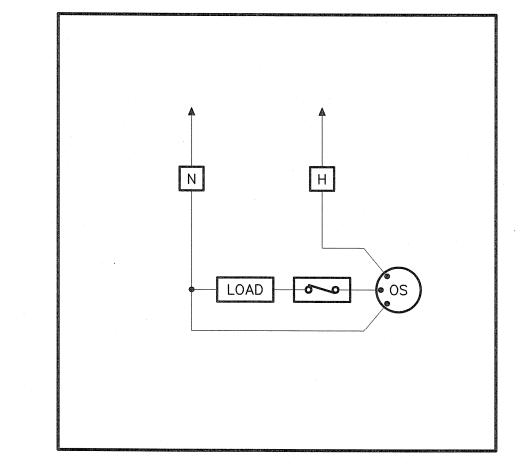

TYPICAL LINE VOLTAGE 2 POLE

| B | HIGH BAY SENSOR LINE DIAGRAM |
| E6.2 | SCALE: N.T.S.



Certificate of Authorization
MCW/AGE Consulting
Professional Engineers
No. 589 Expiry: April 30, 2010

D	ISSUED	FOR	TEN	DER
C	ISSUED	FOR	99%	REVIEW
В	ISSUED	FOR	90%	REVIEW
A	ISSUED	FOR	60%	REVIEW

R FEB 26, 2010
EVIEW FEB 10, 2010
EVIEW JAN 08, 2010
EVIEW DEC 02, 2009

This drawing must not be scaled.

The general Contractor must verify all dimensions, datums and levels prior to commencement of work. All errors and omissions must be reported immediately to the Architect.

Variations and modifications to work shown on this drawing shall not be carried out without written permission from the

This drawing is the exclusive property of the Architect and cannot be reproduced without written permission of the Architect. Reproduction must bear the name of the Architect. Copyright © 2009.



Consulting Professional Engineers
210-1821 Wellington Avenue
Winnipeg, Manitoba, R3H 0G4
Phone - (204) 779-7900 Fax - (204) 779-1119
E-Mail: mcw_wpg@mcw.com



proj

SINCLAIR COMMUNITY
CENTRE
ADDITION & RENOVATIONS
490 Sinclair Street, Winnipeg

sheet title

DETAILS

	instruction to the temperature of the contraction o	Charles som et in the internet of the control of th
ject numbe	r: 5878	drawing number:
le:	N.T.S.	
wn by:	P.A.S.	
roved by:	K.B.G.	
e:	2010-02-26	