


WET WELL MECHANICAL ROOM



NO.	CONSTRUCTION NOTES
1	COORDINATE WITH CITY FOR REMOVAL OF EXISTING SHELVING.
2	DRILL HOLE THROUGH FLOOR TO WET WELL BELOW FOR G608-PDT. MARK OUT LOCATION OF REINFORCING STEEL PRIOR TO DRILLING TO AVOID CUTTING THROUGH STEEL. RUN STAINLESS STEEL TUBING ALONG WALL TO G608-PDT.
3	CONNECT PRESSURE TRANSMITTER TUBING TO ATMOSPHERE. SEE DETAIL ON 1-0102G-A0128.
4	PRESSURE TRANSMITTER TO BE HAZARDOUS CLASS 1, ZONE 2 RATED AS THE IMPULSE LINE IS CONNECTED TO THE WET WELL.
5	MOUNT JUNCTION BOXES ON UNISTRUT SUPPORTS.
6	INSTALL CONCRETE HOUSEKEEPING PAD UNDER ELECTRICAL EQUIPMENT. SEE 1-0102A-S0001 FOR DETAILS.
7	PROVIDE A DUPLEX RECEPTACLE FOR GLYCOL MAKE UP UNITS G603-GMU AND G605-GMU. PROVIDE CABLE FEEDING RECEPTACLE FROM PNL-3G.
8	PROVIDE NEW INSTRUMENT AIR PIPING FOR G686-XV. PAINT NEW PIPING TO MATCH EXISTING.

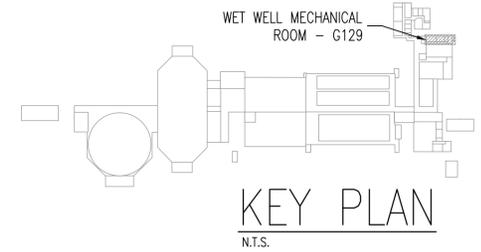

NOTES:

- THIS DRAWING SUPERCEDES PART OF SEP-837.



NO.	REVISIONS	DATE	DESIGN	CHECK
01	ISSUED FOR TENDER, BID OPP. 42-2013	2013/01/15	TMC	CJR
00	ISSUED FOR TENDER, BID OPP. 545-2012	2012/11/21	TMC	CJR

<p>SNC-LAVALIN INC. 148 Nature Park Way Winnipeg, MB, Canada R3P 0X7 204-786-8080</p>		ENGINEER'S SEAL
DESIGNED BY: I. CHURCH	CHECKED BY: C. REIMER	
DRAWN BY: M.J. PERSSON	APPROVED BY: C. REIMER	
SCALE: 1 : 30	RELEASED FOR CONSTRUCTION BY: N. HARRINGTON	
DATE: 2012/01/26	DATE: 2012/10/19	
CONSULTANT NO.: 112577-0116-4800-0002		



SOUTH END WATER POLLUTION CONTROL CENTRE  
VENTILATION & MISC UPGRADES  
INSTRUMENT LOCATION PLAN  
WET WELL MECHANICAL ROOM - G129

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0102G-A0097	001	01	A1

1-0102G-A0095	P&ID, WET WELL SUPPLY AND EXHAUST FANS, G602-SF, G686-EF, G687-EF
1-0102G-A0094	P&ID, WET WELL UPPER LEVEL HVAC, G601-SF
DRAWING NUMBER	REFERENCE DRAWINGS