


NEW PANEL 'K' & 'L' 120/208V,
3 ϕ , 4W PANELBOARD
NEW LIGHTING CONTROL
PANEL
NEW PANEL 'M' & 'N' 120/208V,
3 ϕ , 4W PANELBOARD

UPPER LEVEL - WEST END
1/16" = 1'-0"

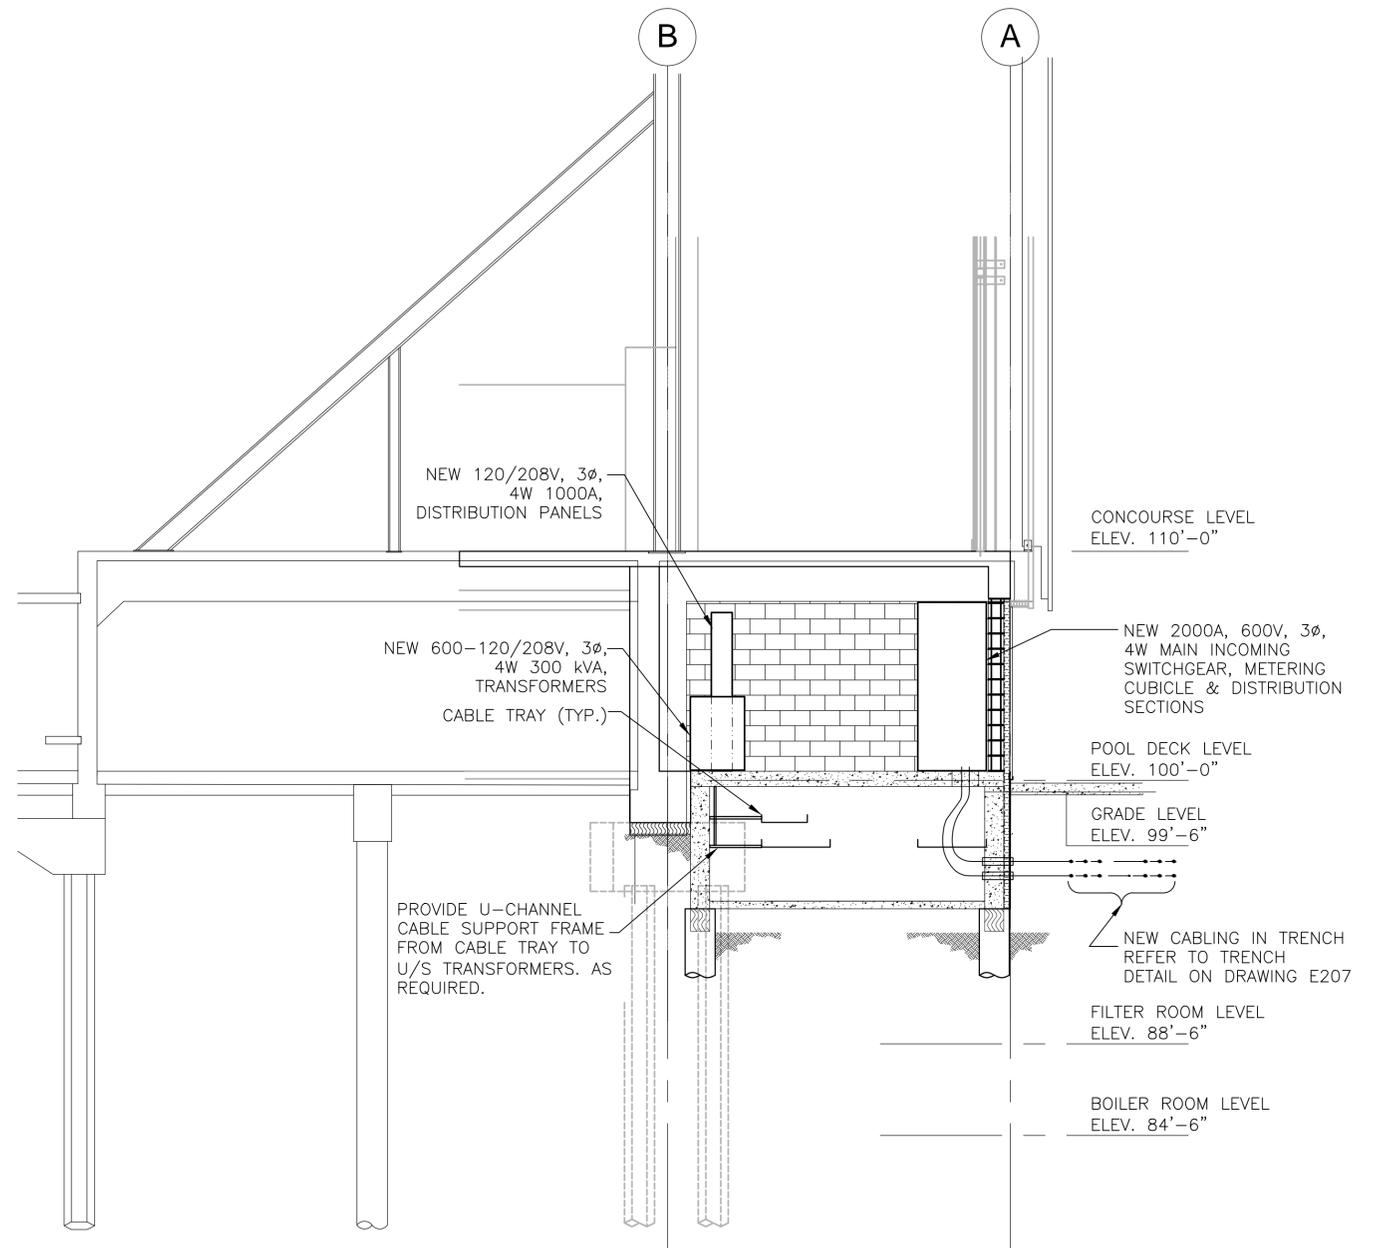

NEW 120/208V, 3 ϕ ,
4W 1000A,
DISTRIBUTION PANELS

NEW 600-120/208V, 3 ϕ ,
4W 300 kVA,
TRANSFORMERS
CABLE TRAY (TYP.)

PROVIDE U-CHANNEL
CABLE SUPPORT FRAME
FROM CABLE TRAY TO
U/S TRANSFORMERS. AS
REQUIRED.

CONCOURSE LEVEL
ELEV. 110'-0"

NEW 2000A, 600V, 3 ϕ ,
4W MAIN INCOMING
SWITCHGEAR, METERING
CUBICLE & DISTRIBUTION
SECTIONS

POOL DECK LEVEL
ELEV. 100'-0"

GRADE LEVEL
ELEV. 99'-6"

NEW CABLING IN TRENCH
REFER TO TRENCH
DETAIL ON DRAWING E207

FILTER ROOM LEVEL
ELEV. 88'-6"

BOILER ROOM LEVEL
ELEV. 84'-6"

SECTION - NEW ELECTRICAL RM.
1/4" = 1'-0"

Conditions of Use
Verify elevations and/or dimensions on drawing prior to use.
Report any discrepancies to Dillon Consulting Limited.
Do not scale dimensions from drawing.
Do not modify drawing, re-use it, or use it for purposes other
than those intended at the time of its preparation without prior
written permission from Dillon Consulting Limited.



DESIGN	BLM	REVIEWED BY	
DRAWN	SCK	CHECKED BY	
DATE	APR 3, 2013		
SCALE	AS SHOWN		
No.	ISSUED FOR BID OPPORTUNITY NUMBER 850-2013	DATE	13-11-20
	ISSUED FOR	DATE	

PAN AM POOL ELECTRICAL UPGRADE

PROJECT NO.
137300

ELECTRICAL
UPPER LEVEL - WEST & SECTION

SHEET NO.
E206