



WINNIPEG

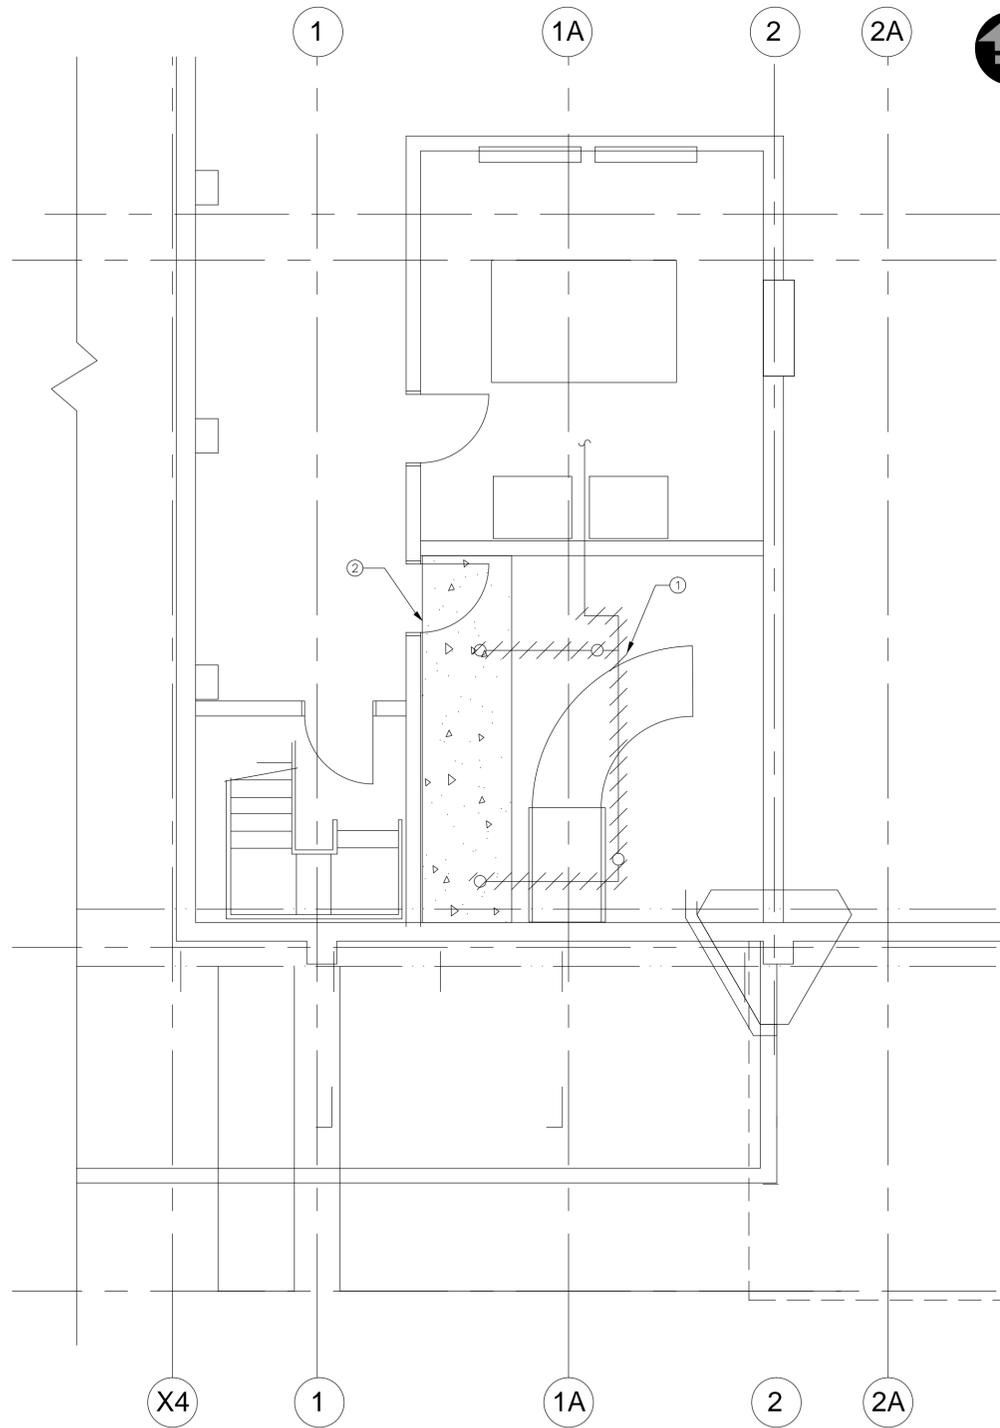

- ① REMOVE EXISTING SPRINKLER SERVICE TO ALLOW FOR DEMOLITION OF DUCTBANK AND THE INSTALLATION OF THE NEW CABLE TRAY.
- ② EXISTING DUCTBANK TO BE DEMOLISHED BY GENERAL CONTRACTOR AND ELECTRICAL CONTRACTOR

CRAWLSPACE LEVEL - DEMOLITION PLAN
1/4" = 1'-0"

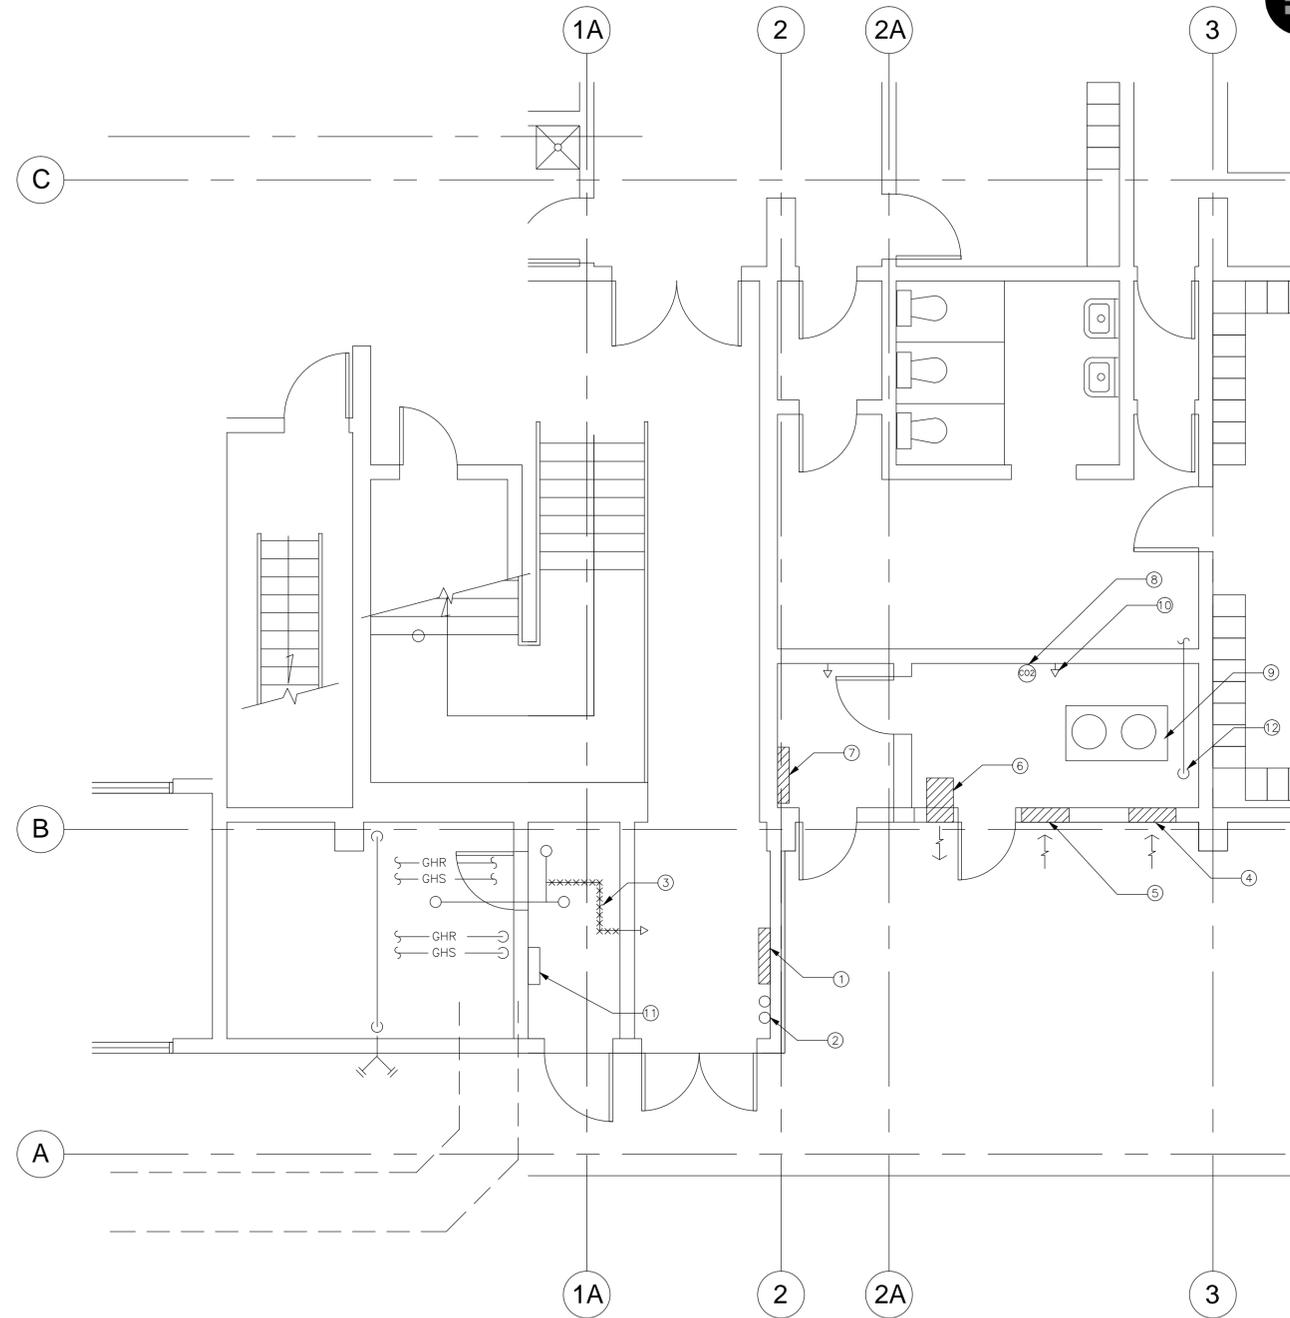

MAIN FLOOR DEMOLITION PLAN
1/4" = 1'-0"

- DEMOLITION NOTES:**
- ① REMOVE AND CLEAN EXISTING FORCEFLOW UNIT FROM ATHLETE ENTRY TO ALLOW FOR THE DEMOLITION OF THE WALL UNIT TO BE REINSTALLED AT LATER DATE.
 - ② REMOVE GHS AND GHR DROPS AT WALL TO ALLOW FOR THE DEMOLITION OF THE WALL. GLYCOL SOLUTION TO BE DRAINED BACK TO GLYCOL FEED SYSTEM IN DELIVERY ROOM. CAP LINES.
 - ③ REMOVE SIDEWALL SPRINKLER HEAD AND ASSOCIATED PIPING FOR THE DEMOLITION OF THE EXISTING WALL. CAP REMAINING SERVICE.
 - ④ REMOVE EXISTING 12" x 12" LOUVRE
 - ⑤ REMOVE EXISTING 12" x 12" LOUVRE.
 - ⑥ REMOVE EXISTING EXHAUST FAN, DUCTWORK, LOUVRE AND SUPPORTS. COORDINATE THE INFILL OF THE OPENING WITH THE GENERAL CONTRACTOR.
 - ⑦ REMOVE EXISTING FORCE FLOW UNIT FROM WALL TO ALLOW FOR THE INSTALLATION OF A NEW DOOR.
 - ⑧ EXISTING CO2 SENSOR TO REMAIN.
 - ⑨ EXISTING SCALE FOR CO2 TANKS TO REMAIN.
 - ⑩ EXISTING SIDEWALL SPRINKLER HEAD TO REMAIN.
 - ⑪ EXISTING FORCE FLOW UNIT TO REMAIN.
 - ⑫ EXISTING PIPE TO REMAIN.

Conditions of Use
Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.
Do not scale dimensions from drawing.
Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.



DESIGN	JDB	REVIEWED BY	PDT
DRAWN	JV	CHECKED BY	JDB
DATE	JUNE 6, 2013		
SCALE	1/4" = 1'-0"		
No.	ISSUED FOR	DATE	BY
0	ISSUED FOR BID OPPORTUNITY NUMBER 850-2013	13-11-20	SCK

PAN AM POOL ELECTRICAL UPGRADE

PROJECT NO.
137300

MECHANICAL DEMOLITION PLANS

SHEET NO.
M201