


FIELD

JB IN FIELD

PUMP CONTROLLER

RTU PANEL

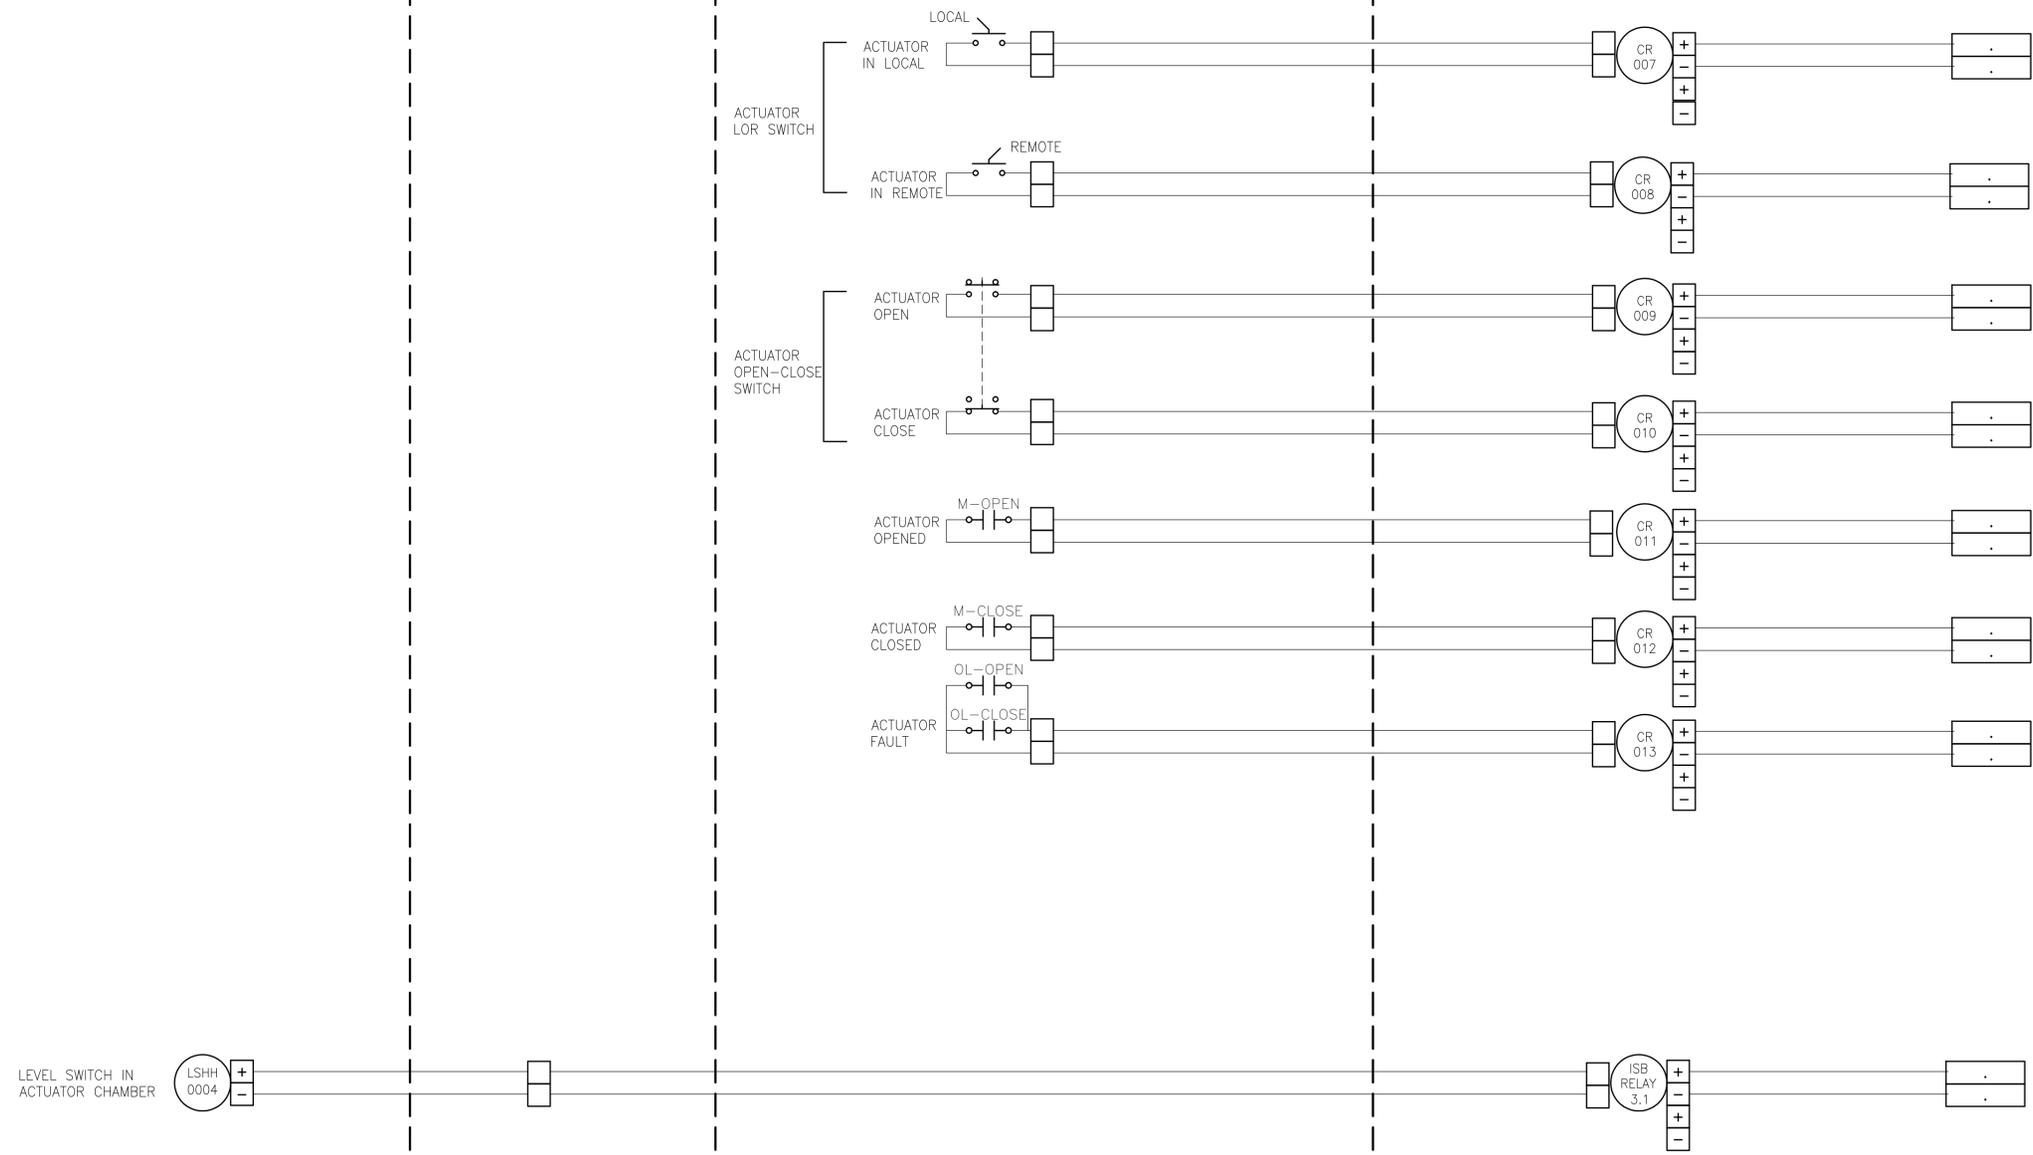

NOTE:  
1. PLC ANALOG INPUTS ARE SINGLE-ENDED TYPE. RTU-000

Printed: November 12, 2013 at 4:10:10 PM | Last Saved By: C:\app  
 File: C:\1325513108-000 (McDermot Ave Outfall Gate Chamber)\10 - electrical\Sheet07.dwg | Layout: 17-2



		MMM Group Limited Suite 111 - 93 Lombard Ave. Winnipeg, MB R3B 3B1 T. 204.943.3178   F. 204.943.4949 www.mmm.ca	
DESIGNED BY	J.D.S./M.P.	CHECKED BY	M.P./D.C.
DRAWN BY	R.D.	APPROVED BY	K.H.
HOR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERT. SCALE	AS NOTED		
No.	REVISIONS	DATE	BY
B	ISSUED FOR TENDER	13.11.12	M.P.
A	ISSUED FOR CLIENT REVIEW	13.11.04	M.P.
		13.10.16	
		13.10.16	

ENGINEER'S SEAL

BID OPPORTUNITY: 902-2013  
PLOT DATE: 13.10.16

**THE CITY OF WINNIPEG**  
 WASTE AND WATER DEPARTMENT  
 Winnipeg

CONSULTANT DRAWING No.:  
 17 - SHT 2 OF 2  
 SHEET 22 OF 22  
 CITY DRAWING No.:  
 LD-7267

OUTFALL GATE CHAMBER UPGRADES  
**McDERMOT**  
 RSR OUTFALL GATE CHAMBER  
 LOOP DIAGRAMS