


- 1. PAD SIZE SHALL BE MINIMUM INDICATED OR AS SHOWN ON THE PLANS OR AS INDICATED BY THE MANUFACTURER AND APPROVED BY THE ENGINEER.
- 2. THE SIZE, NUMBER, TYPE, LOCATION, AND THREAD PROJECTION OF THE ANCHOR BOLTS SHALL BE DETERMINED BY THE EQUIPMENT MANUFACTURER AND AS APPROVED BY THE ENGINEER. ANCHOR BOLTS SHALL BE HELD IN POSITION WITH A TEMPLATE OR OTHER ACCEPTABLE MEANS, MATCHING THE BASE PLATE, WHILE PAD IS BEING PLACED.
- 3. ANCHOR BOLT SLEEVES SHALL BE USED TO PROVIDE MINIMUM ANCHOR BOLT MOVEMENT OF 13mm IN ALL HORIZONTAL DIRECTIONS. THE MINIMUM SLEEVE LENGTH SHALL BE 8 TIMES THE BOLT DIAMETER.
- 4. ANCHOR BOLT SLEEVES SHALL HAVE A MINIMUM INTERNAL DIAMETER 25mm GREATER THAN BOLT DIAMETER AND A MAXIMUM INTERNAL DIAMETER 75mm GREATER THAN ANCHOR BOLT DIAMETER. SLEEVES SHALL BE FILLED WITH NON-SHRINK GROUT AFTER BOLTS ARE ALIGNED.
- 5. EQUIPMENT BASES SHALL BE INSTALLED LEVEL UNLESS INDICATED OTHERWISE.
- 6. WEDGES, SHIMS, OR LEVELING NUTS SHALL BE USED TO SUPPORT THE BASE WHILE THE NON-SHRINK GROUT IS PLACED. WEDGES OR SHIMS THAT ARE LEFT IN PLACE SHALL NOT BE EXPOSED TO VIEW.
- 7. HEIGHT OF PADS SHALL BE MINIMUM REQUIRED FOR ANCHOR BOLT CLEARANCE TO KEEP ANCHOR BOLT ABOVE SUPPORTING SLAB (SEE TABLE BELOW).
- 8. AT CONTRACTOR'S OPTION, CONCRETE ANCHORS MAY BE USED IN LIEU OF CAST—IN—PLACE ANCHOR BOLTS FOR EQUIPMENT ANCHOR BOLTS LESS THAN 20mm DIAMETER WHEN APPROVED BY THE EQUIPMENT MANUFACTURER AND APPROVED BY THE ENGINEER. ANCHORS SHALL BE INSTALLED WITH 100mm MINIMUM EDGE DISTANCE IN EACH DIRECTION.

| AB DIA (mm) | 12 | 16 | 20 | 22 | 25 | 33 | 35 | 38 | 44 | 50 |
|-----------------|-----|-----|-----|-----|-----|-----|-----|-----|-----|-----|
| MIN PAD HT (mm) | 175 | 215 | 250 | 275 | 320 | 380 | 420 | 450 | 535 | 600 |

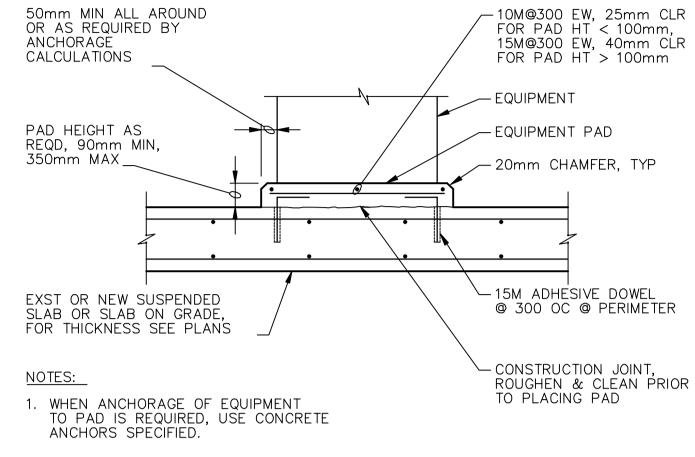


TYPE E

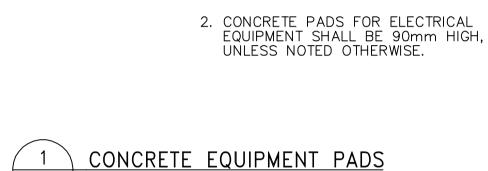

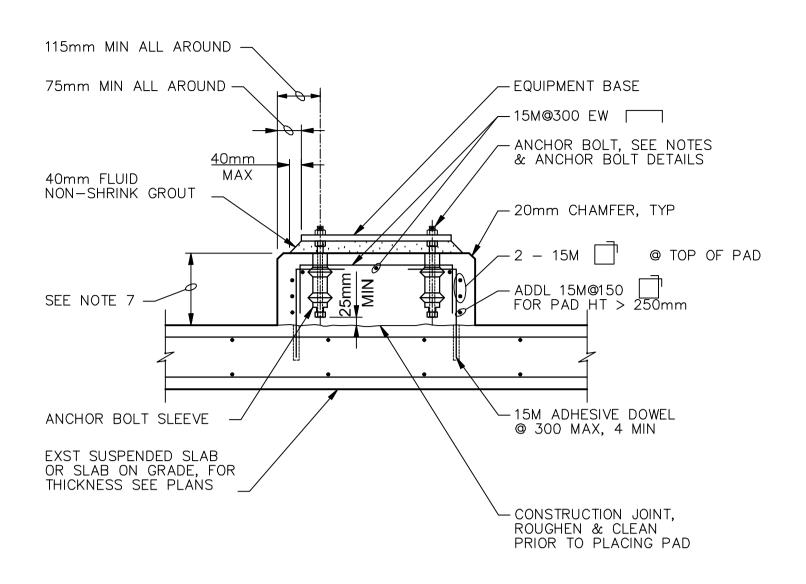

TYPE F

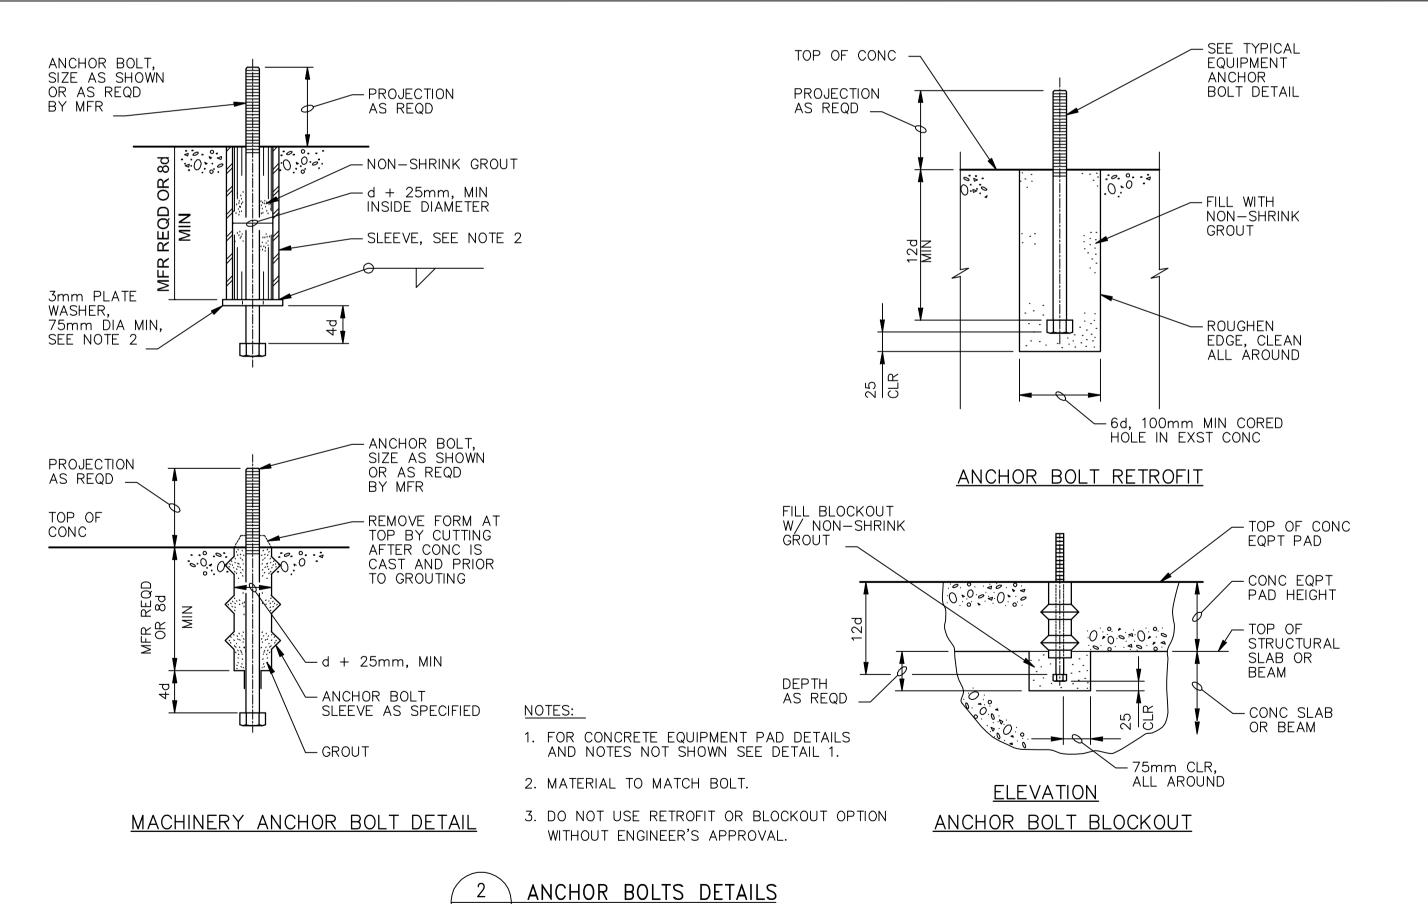


Certificate of Authorization

CH2M HILL Canada Ltd.

No. 1441 Date: 2014 01 21

N.T.S.

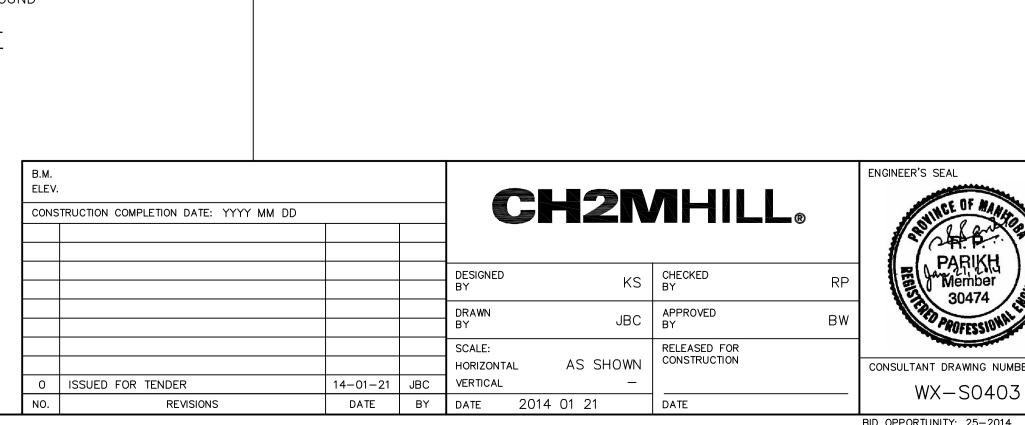

ENGINEER'S SEAL PARIKH 30474 CONSULTANT DRAWING NUMBER

Winnipeg

THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT

MEZZANINE, WALKWAY AND EQUIPMENT SUPPORTS FOR A WATER TREATMENT RESEARCH AND PROCESS OPTIMIZATION FACILITY STRUCTURAL

STANDARD DETAILS 1-0601X-S0004-003-00 SHEET 3 OF 4

SHEET 8 OF 9

CITY DRAWING NUMBER

ENGINEERING DIVISION

BID OPPORTUNITY: 25-2014 CONTRACT NUMBER: X

FILE PATH: \\WINNIPEG\Proj\WinnipegCityof\462784Waterworks\DMS\DLV\FILE NAME: 462784-S-0403.dwg