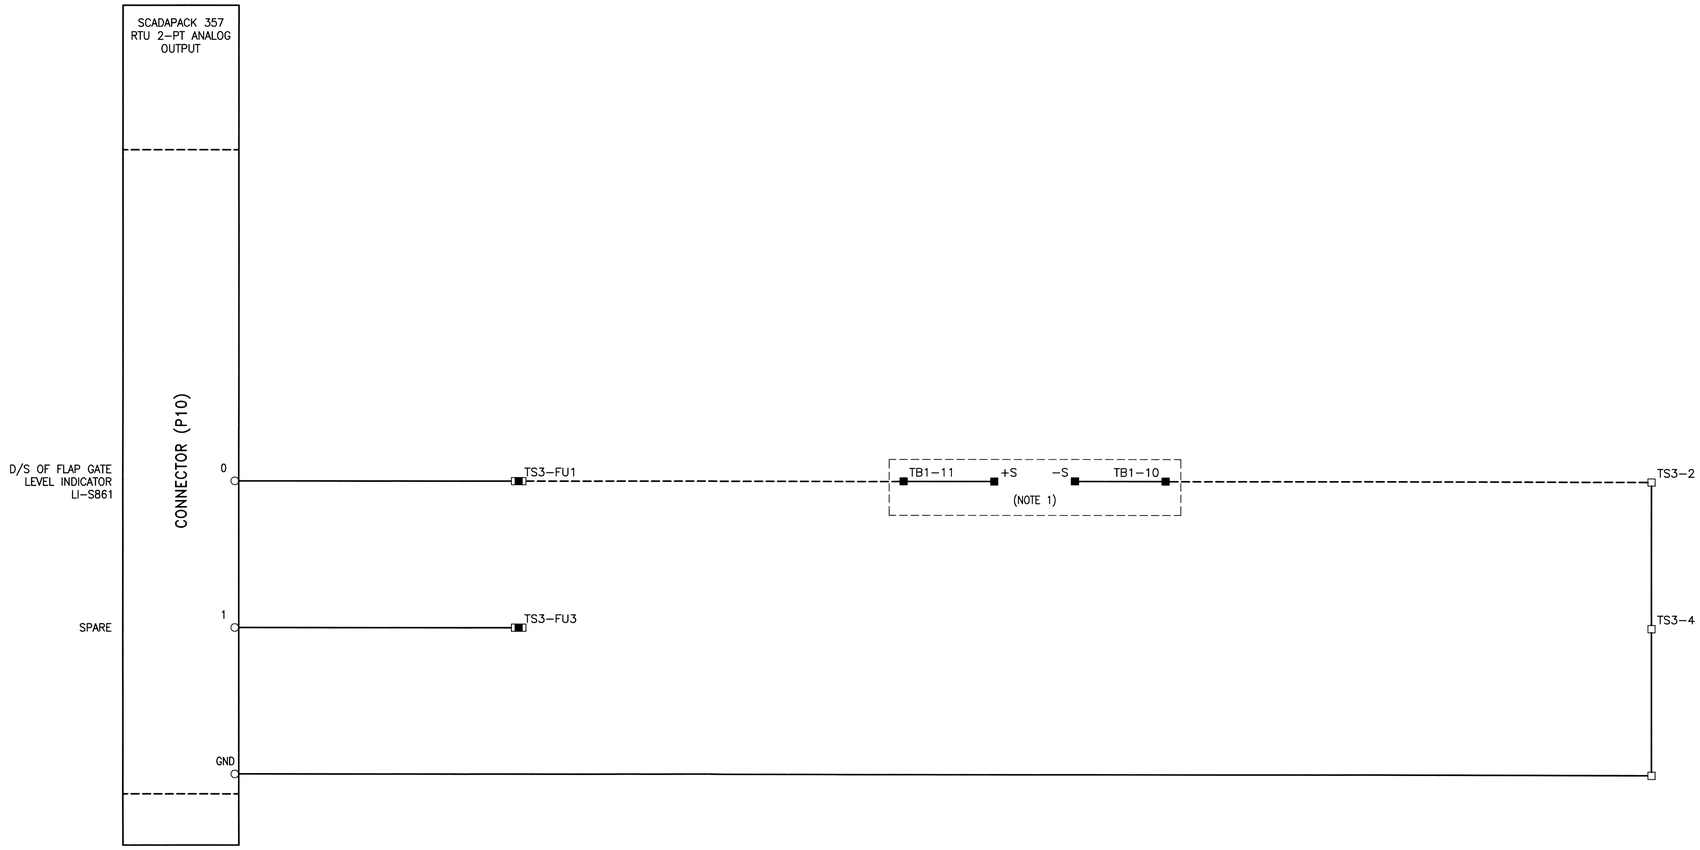

NOTES:

1. REFER TO DRAWING 1-0115-A0204-001 FOR ADDITIONAL DETAILS ON CSO OUTFALL I/O.

LEGEND:

□	RTU TERMINAL
⊠	FIELD DEVICE TERMINAL
▣	FUSED TERMINAL
———	PANEL WIRING
- - - - -	FIELD WIRING

APEGM
Certificate of Authorization
KGS Group
No. 245

NO.	REVISIONS	DATE	BY
	POSTED TO LBIS		
0	ISSUED FOR CONSTRUCTION	14/08/18	AP

KGS GROUP CONSULTING ENGINEERS

DESIGNED BY DDW/MAM	CHECKED BY
DRAWN BY GCN	APPROVED BY
HOR. SCALE N.T.S. VERTICAL	RELEASED FOR CONSTRUCTION
DATE 2014 01 17	DATE

ENGINEER'S SEAL
PROVINCE OF MANITOBA
A.W.P. PAWLIKEWICH
Member
12336
REGISTERED PROFESSIONAL ENGINEER

A-E29

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

FLOOD PUMPING STATION UPGRADES
ASSINIBOINE STATION
ELECTRICAL
RTU PANEL BASE I/O BOARD
ANALOG OUTPUTS

SHEET 1 OF 1
CITY DRAWING NUMBER
1-0115F-E0014-001

CW-9-M564-1
FileName: P:\Projects\2013\13-0107-026\Dwg\Elec\13-0107-026-A-E29.dwg - Tab: E29 Plotted By: dderoche 08/19/2014 [Tue 8:54am]