




FIRE PROTECTION GENERAL NOTES


- A. THE SPRINKLER CONTRACTOR SHALL INSTALL A COMPLETE SPRINKLER SYSTEM AS NOTED ON THE DRAWINGS AND SPECIFICATIONS.
- B. THE SPRINKLER CONTRACTOR SHALL PREPARE ALL NECESSARY DETAILED DESIGN DRAWINGS AND/OR DOCUMENTS AND SUBMIT TO THE ENGINEER FOR REVIEW AND COORDINATION. ENSURE COMPLETE SPRINKLER COVERAGE IN COMPLIANCE WITH NFPA 13, AND RELATED APPLICABLE NFPA CODES.
- C. THE INSTALLATION OF SPRINKLER SYSTEMS SHALL NOT COMMENCE UNTIL THE COMPLETE SHOP DRAWINGS AND SPECIFICATIONS HAVE BEEN APPROVED BY THE AUTHORITY HAVING JURISDICTION (A.H.J.).
- D. IN AREAS WITH SUSPENDED TILE CEILINGS INSTALL SPRINKLER HEADS CENTRED ON THE TILES. ALLOW FOR ADDITIONAL HEADS IF NECESSARY TO MEET THIS REQUIREMENT.
- E. THE SPRINKLER CONTRACTOR SHALL CONFIRM ON SITE THE LOCATIONS OF EXISTING STRUCTURES, EQUIPMENT, AND SYSTEMS FOR INTERFERENCE AND COORDINATION PURPOSES. INCLUDE ALL OFFSETS, ADDITIONAL LOW-POINT DRAINS, ADDITIONAL HEADS AS REQUIRED. ROUTE BRANCH LINES AS REQUIRED.
- F. GRADE ALL NEW PIPING TO ALLOW COMPLETE SYSTEM DRAINAGE. DRAINAGE SHALL BE ROUTED TO THE NEAREST SANITARY DRAIN OF SUFFICIENT SIZE. COORDINATE WITH PLUMBING CONTRACTOR. DRAINAGE TO STORM DRAINAGE PIPING OR SUMP PITS IS NOT PERMITTED.
- G. THE SPRINKLER INSTALLATION SHALL COMPLY WITH THE APPLICABLE NFPA CODES AND REQUIREMENTS OF THE A.H.J. IF THERE IS A CONFLICT WITH THE PERCEIVED INTENT OF THIS DRAWING SET AND THE REQUIREMENTS OF NFPA OR THE A.H.J. NOTIFY THE ENGINEER TO RESOLVE. NO INCREASES TO THE CONTRACT WILL BE PERMITTED FOR COMPLIANCE WITH MINIMUM CODE REQUIREMENTS.
- H. THE SPRINKLER CONTRACTOR SHALL SUPPLY AND INSTALL FIRE EXTINGUISHERS AND CABINETS IN COMPLIANCE WITH NFPA 10. COORDINATE EXTINGUISHER AND CABINET TYPE WITH ARCHITECTURAL DRAWINGS AND SPECIFICATIONS.

KEY NOTES

- 1. ADJUST SPRINKLER HEADS WITHIN THE SHADED AREA TO MEET THE NEW ARRANGEMENT AS SHOWN ON ARCHITECTURAL PLANS. AREA IS TO REMAIN LIGHT HAZARD.
- 2. EXISTING HEADS TO REMAIN.
- 3. PROVIDE NEW PENDANT WITHIN CLOSET SPACE.
- 4. DEMOLISH EXISTING FIRE EXTINGUISHER SYSTEM WITHIN EXISTING KITCHEN FUME HOOD.

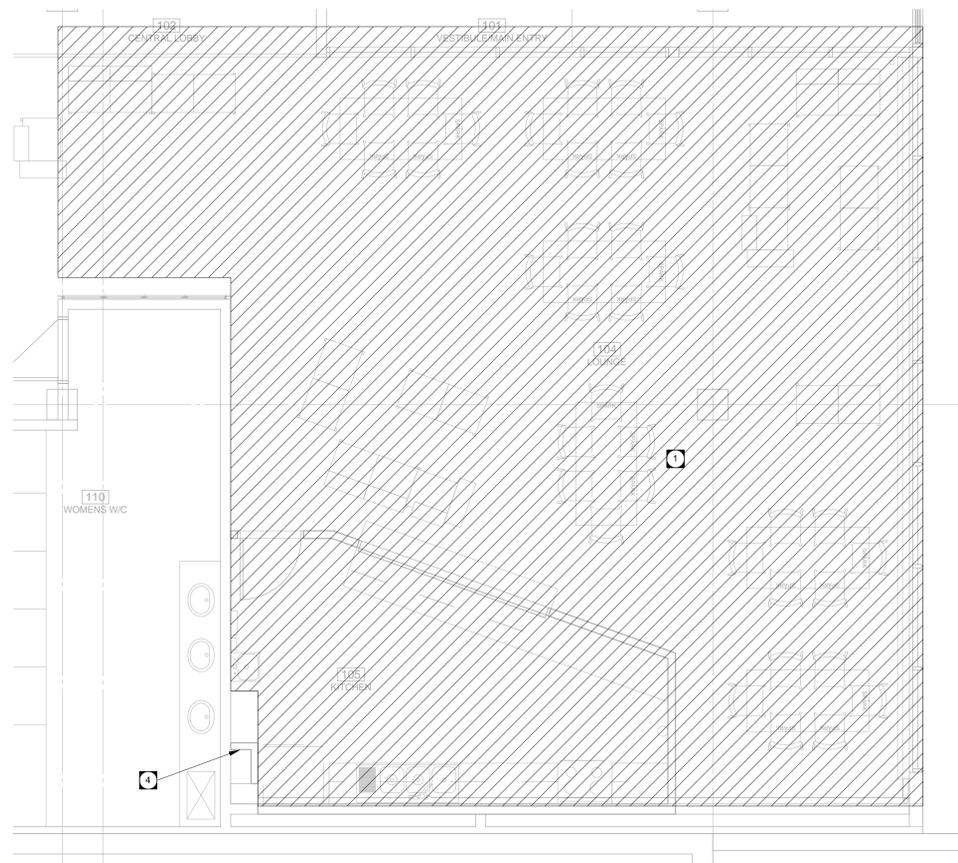

1 MAIN FLOOR PARTIAL PLAN - FIRE PROTECTION ZONE 1
 MF2.1 SCALE: 1 : 50

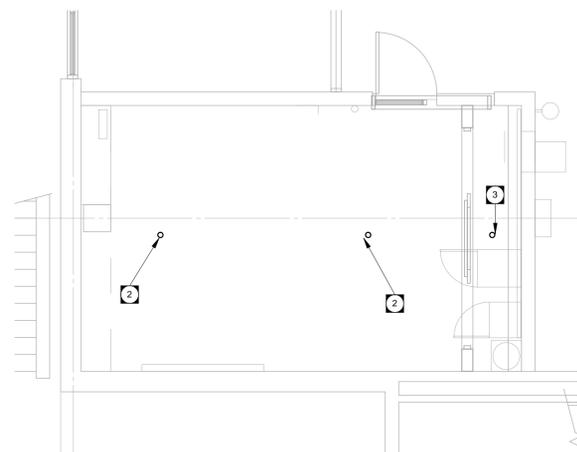

2 MAIN FLOOR PARTIAL PLAN - PLUMBING ZONE 4
 MF2.1 SCALE: 1 : 50

SPRINKLER SYMBOLS

○	UPRIGHT SPRINKLER
●	PENDENT SPRINKLER
⊗	SPRINKLER WITH GUARD
▽	SIDEWALL SPRINKLER
⊗	RISER

O 16-02-29 Issued for Construction

No. DATE: REVISION / ISSUANCE

Seal



Architect

x | architecture inc.
 100 Fort Street, Suite 100 Winnipeg, Manitoba R5C 1C7 204.316.2016

Engineer

epp siepman engineering inc.

mechanical & electrical engineers
 303-100 Osborne St. South p. 204.453.1060
 Winnipeg, MB
 R5L 1Y6 ese@eppsiepman.com

Project: BID OPPORTUNITY 1034-2015

PAN AM POOL INTERIOR RENOVATION

25 POSEIDON BAY

Sheet Title

MAIN FLOOR - FIRE PROTECTION PLAN

Project No. 15087

Date: FEB 29 2016

MF2.1