


- CRANE PAD MINIMUM REQUIREMENT NOTES:**
1. THE CONTRACTOR SHALL BE SOLELY RESPONSIBLE FOR THE ADEQUACY OF ALL TEMPORARY CRANE PADS. LOCATIONS OF CRANE PADS SHALL BE SUBMITTED TO THE CONTRACT ADMINISTRATOR FOR APPROVAL.
 2. ALL CRANE PADS SHALL BE A MINIMUM OF 5 m CLEAR FROM EXISTING OUTSIDE FACE OF CONCRETE RESERVOIR FOUNDATION WALL TO THE INSIDE FACE OF THE TIMBER CRANE MAT.
 3. ALL CRANE PADS SHALL UTILIZE A MINIMUM THICKNESS OF 600 mm OF 150 mm DOWN CLEAN CRUSHED LIMESTONE OVER A NON-WOVEN GEOTEXTILE FABRIC. TOP LAYER OF ROCKFILL SHALL BE 50 mm DOWN CRUSHED LIMESTONE.
 4. MINIMUM SIZE OF FIR TIMBER CRANE MAT SHALL BE 300 mm DEEP AND MECHANICALLY SECURED TO PREVENT ROLLING OR DISLODGEEMENT.
 5. CRANE PAD GRANULAR MATERIAL SHALL BE SPREAD, GRADED AND COMPACTED ON NON-WOVEN GEOTEXTILE FABRIC TO A 300 mm THICKNESS IN THE AREAS INDICATED ON THE DRAWINGS.

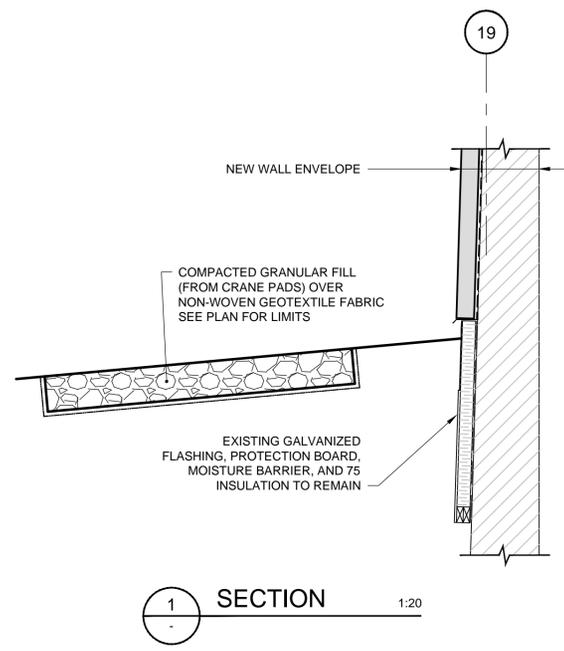

LIMITS OF CRANE PAD AREAS AND MISCELLANEOUS SITE WORK
1:400

METRIC WHOLE NUMBERS INDICATE MILLIMETRES DECIMALIZED NUMBERS INDICATE METRES	 Certificate of Authorization Dillon Consulting Limited (MB) No. 1789 Date: 2015-08-31	LOCATION APPROVED UNDERGROUND STRUCTURES N/A SUPV. U/G STRUCTURES COMMITTEE _____ DATE _____	B.M. ELEV. _____ CONSTRUCTION COMPLETION DATE: _____	CHECKED BY: DRA APPROVED BY: SSR DESIGNED BY: FAK DRAWN BY: TLK	 RELEASED FOR CONSTRUCTION CONSULTANT DRAWING NUMBER 14-1411-C-103	ENGINEER'S SEAL SHEET 7 OF 47 CITY DRAWING NUMBER 1-0650R-C0004-001
		NOTE: LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.	SCALE: HORIZONTAL AS NOTED VERTICAL _____	1 ISSUED FOR TENDER 2015 11 20 NO. REVISIONS DATE BY DATE		