


PARTS LIST			
ITEM	QTY	PART NUMBER	DESCRIPTION
1	2	7000TUBE-10	3/8"X 10' LONG, DRN TUBE HOSE
2	2	CCA08ADBK	AERCO ADAPTER
3	4	CCA08AJ	LONG ADJUSTABLE LENGTH
4	2	CCA08L36	08" DIAMETER CI PLUS 36" LENGTH
5	2	CCL08RJ	ROOF JACK SUPPORT SYSTEM
6	2	41027SS	SUPPORT CLAMP
7	2	CCA08E90	90° ELBOW
8	4	CCM08PSC	PITCHED STORM COLLAR
9	2	CCA08EX06	EXIT CONE
10	2	CCA08L18	08" DIAMETER CI PLUS 18" LENGTH
11	2	CCA08L24	08" DIAMETER CI PLUS 24" LENGTH
12	8	CCA08L48	08" DIAMETER CI PLUS 48" LENGTH
13	6	CCA08GUY	GUY SUPPORT SECTION
14	2	CCA08DCV	TEE COVER WITH-DRAIN FITTING
15	2	CCA08BT	BOOT TEES

GENERAL NOTES:

- 1.) ALL HORIZONTAL RUNS MUST BE PITCHED UPWARD 1/4-INCH PER FOOT SO THAT CONDENSATE DRAINS BACK TOWARD THE APPLIANCE OR INLINE DRAIN.
- 2.) FOR 16"Ø AND UNDER, USE THE SILICONE GASKET LUBRICANT (DI-ELECTRIC GREASE, P/N 70015IL-5) QUOTED WITH THIS JOB.
- 3.) HORIZONTAL SUPPORTS ARE REQUIRED EVERY 6 FEET, AT EACH TRANSITION FROM VERTICAL, AND AT EACH ADJUSTABLE SECTION.
- 4.) INSTALLER IS TO FIELD VERIFY ALL DIMENSIONS AND PARTS ON THE PARTS LIST BEFORE ORDERING FROM THIS DRAWING.
- 5.) ALL APPLIANCE MANUFACTURER AND HEATFAB INSTALLATION INSTRUCTIONS, AS WELL AS ANY LOCAL OR NATIONAL CODES, SHOULD BE FOLLOWED WHEN INSTALLING THIS SYSTEM.

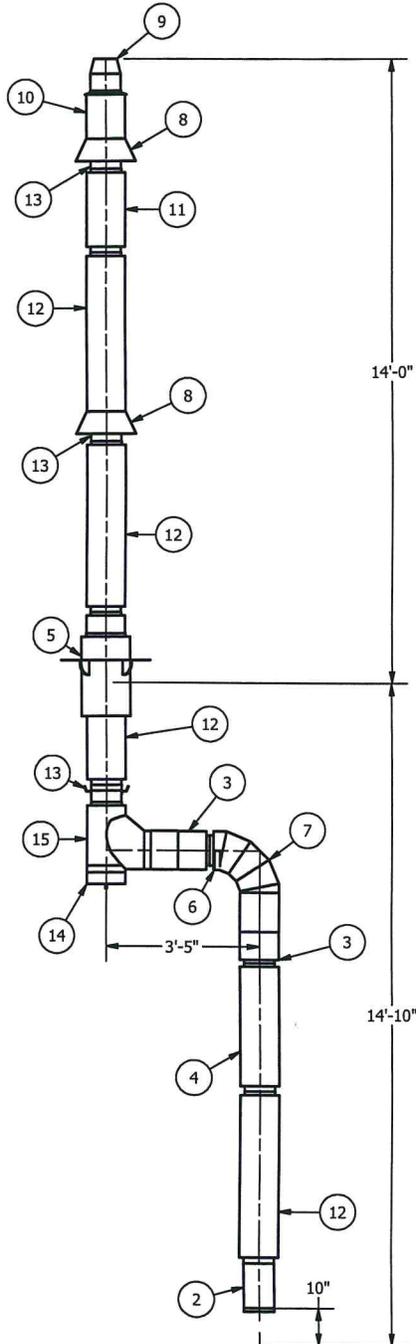

**CITY OF WINNIPEG
FORT ROUGE TRANSIT BASE
SERVICE BAY AND B-SECTION
VENTILATION UPGRADE**

Detail Sheet: MD-10

Detail Name: Boiler Venting Detail

THE ITEM(S) CONTAINED IN THIS BILL OF MATERIALS WILL BE BUILT SOLELY FOR THIS JOB. THEREFORE, THIS DOCUMENT MUST BE FIELD VERIFIED AND/OR APPROVED BEFORE THE ORDER WILL BE ENTERED FOR MANUFACTURING.

APPROVAL SIGNATURE _____
TITLE HELD _____
DATE OF APPROVAL _____

heatfab®
Commercial/Industrial Air Distribution Systems Grand Rapids, Michigan

REPRESENTATIVE:
R-G SALES COMPANY LTD

TITLE: **FORT ROUGE TRANSIT**

DWN. BY: cfostew1	APPR.:	SHEET NO:
DATE: 11/20/2015	DATE:	1 / 1
SCALE:	DWG. NO.:	SHEET SIZE:
3/8" = 1'-0"	H5315N477	11 X 17 (Inches)

ELEVATION VIEW
Typical For Two