



- A. ALL WIRING INDOORS TO BE RW90 COPPER IN EMT CONDUIT UNLESS OTHERWISE NOTED.
- B. PROVIDE BOND CONDUCTOR IN ALL CONDUIT RUNS.
- C. REMOVE ALL ABANDONED EQUIPMENT AND SERVICES WITHIN AREA OF WORK.
- D. THIS BUILDING MAY CONTAIN ASBESTOS. REFER TO FRONT SPECIFICATIONS FOR FURTHER INFORMATION.

1. CDP MOUNTED ON END OF MAIN DISTRIBUTION, PANEL #2.
2. EXISTING EQUIPMENT TO BE REMOVED. REMOVE WIRING/CONDUIT BACK TO SOURCE. REFER TO DRAWING E.1.

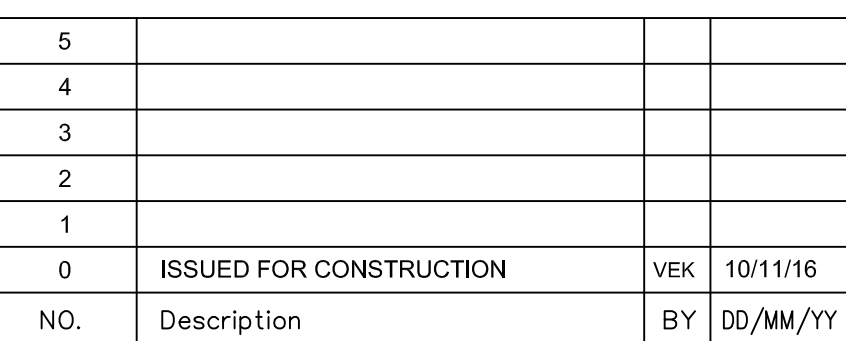

770 Bradford Street
Winnipeg, Canada
T 204 775 0291
SMSeng.com

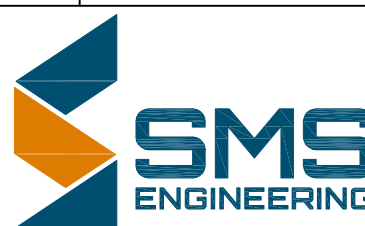

Winnipeg Transit

Project Title
CITY OF WINNIPEG FORT ROUGE
TRANSIT BASE - STORAGE TRACK
1-12 VENTILATION UPGRADE

WINNIPEG

MANITOBA

Drawing Title
DISTRIBUTION SINGLE LINE

Drawn By IN	Checked By VEK	Approved By VEK
Scale AS SHOWN	Date SEPTEMBER 2016	Project No. 16-149-01
Revision Number 0	Drawing Number E3.1	Sheet Order 3 OF 3