

## **GENERAL NOTES**

- A. PIPING SHALL BE DESIGNED AND CONSTRUCTED IN ACCORDANCE WITH ASME B31.9 CODE FOR BUILDING SERVICES PIPING.
- B. INSULATE ALL HYDRONIC PIPING IN ACCORDANCE WITH THE SPECIFICATIONS.
- C. COORDINATE PIPE RUNS IN THE BULKHEAD WITH OTHER TRADES TO AVOID
- D. SUPPORT PIPING IN ACCORDANCE WITH THE MANUFACTURERS RECOMMENDATIONS AND THE SPECIFICATIONS.
- E. FIRESTOP ALL MECHANICAL PENETRATIONS THROUGH FIRE-RATED FLOOR AND WALL ASSEMBLIES. SEE ARCHITECTURAL DRAWINGS FOR LOCATION AND TYPE OF RATINGS
- F. EXPOSED PIPING IN MECHANICAL ROOMS AND CRAWLSPACES AND OCCUPIED AREAS SHALL BE ENCLOSED WITH PVC JACKET.
- G. EXPOSED PIPING IN OCCUPIED SPACES SHALL BE PAINTED BY THE PAINTING
- CONTRACTOR. REFER TO ARCHITECTURAL NOTES. H. REFER TO SCHEMATIC AND DETAILS FOR PIPING AND EQUIPMENT
- ARRANGEMENT. I. WHEN USED IN RETURN-AIR PLENUMS, INSULATION MATERIALS FOR DOMESTIC, HYDRONIC, AND REFRIGERANT PIPING TO MEET SMOKE AND FLAME SPREAD REQUIREMENTS FOR PLENUM INSULATION.
- J. PROVIDE A MINIMUM OF TWO 90-DEGREE CHANGES IN DIRECTION AT EACH BRANCH CONNECTION TO ALLOW FOR PIPE MOVEMENT.
- K. CONTRACTOR TO PROVIDE SHOP DRAWINGS FOR FIELD-FABRICATED EXPANSION LOOPS INCLUDING ANCHORS AND GUIDES.
- L. LAYOUTS ARE SCHEMATIC. ADDITIONAL OFFSETS AND ELBOWS SHALL BE INSTALLED AS REQUIRED TO ACCOMMODATE ALL EXISTING CONDITIONS.
- M. INSTALL VALVES WITH THE STEMS VERTICAL. WHEN THIS IS NOT POSSIBLE, THEY MAY BE INSTALLED ROTATED BUT NEVER LESS THAN HORIZONTAL UNDER ANY CIRCUMSTANCE.
- N. ARRANGE ISOLATION VALVES STAGGERED WHERE THEY ARE INSTALLED IN A COMMON LOCATION SO THEY ARE COMPLETELY AND CONVENIENTLY ACCESSIBLE.
- O. INSTALL VALVES WITH ADEQUATE ROOM TO PERMIT REMOVAL OF THE BONNET, DISK, AND TRIM WITHOUT REMOVING THE VALVE FROM THE LINE.
- P. INSTALLATION SHALL PROVIDE MINIMUM 2050mm (80") OF CLEAR HEAD ROOM THROUGHOUT ALL MECHANICAL ROOMS.
- Q. DRAWING IS SCHEMATIC ONLY. NOT TO BE USED FOR DIMENSIONING.
- R. BALANCER TO TEST AND REPORT PRESSURE DIFFERENTIAL ACROSS EACH AUTOMATIC FLOW CONTROL VALVE.


## KEY NOTES #

- 1. NEW BOILERS TO BE CONNECTED TO MANUFACTURER'S CONTROLLERS. RUN CONDENSATE PIPE TO NEUTRALIZER. INDIRECTLY DISCHARGE CONDENSATE AFTER NEUTRALIZER TO NEAREST FLOOR DRAIN.
- 2. CHILLER WITH REMOTE EVAPORATOR INSTALL ACCORDING TO MANUFACTURER'S REQUIREMENTS INCLUDING SHUTOFF VALVES, FLEXIBLE CONNECTIONS, PRESSURE GAUGES, AND VENTS. INSULATE REMOTE EVAPORATOR AS PER SPECIFICATION.
- 3. CHILLER PRESSURE AND TEMPERATURE GAUGES AND CONTROL VALVES TO BE INSTALLED WITHIN MECHANICAL ROOM.
- 4. INSULATED AIR SEPARATOR AS PER SPECIFICATION.
- 5. NEW PRIMARY ECM PUMPS ARE DUTY/STANDBY IN HEATING AND PARALLEL OPERATION IN COOLING. PUMPS COMPLETE WITH INLINE STRAINER, SHUTOFF VALVES, AND CHECK VALVES. PUMPS ARE TO BE INSULATED AS PER
- 6. IN-FLOOR ECM SECONDARY PUMPS ARE DUTY/STANDBY IN HEATING AND COOLING PUMPS COMPLETE WITH SHUTOFF VALVES, AND CHECK VALVES. PUMPS ARE TO BE INSULATED AS PER SPECIFICATION.
- 7. 3-WAY CONTROL VALVE TO CONTROL SUPPLY WATER TEMPERATURE CONTROL TO THE IN FLOOR MANIFOLDS, CONNECT TO THE DDC.
- 8. UNIT HEATERS ARE TO FLOW CONTINUOUSLY TO MAINTAIN THE MINIMUM FLOW REQUIREMENTS FOR THE PUMPS. INSTALL AUTOMATIC BALANCE VALVES.
- 9. MINIMUM CONTROL PRESSURE VALVE. PRESSURE SENSOR TO BE LOCATED ON MAIN PIPE ON PRIOR TO THE MANIFOLDS. CONNECT PRESSURE SENSOR AND CONTROL BACK TO THE DDC.
- 10. SHUT-OFF VALVES, CONTROL AND BALANCE VALVES SERVING INFLOOR WITHIN THE MANIFOLD ENCLOSURE.
- 11. TIE DDC TO BOILER AND CHILLER CONTROLLERS, MONITOR ALARMS AAND RESET SUPPLY WATER TEMPERATURE REQUIREMENT ONLY.
- 12. INLINE FILTER AND CHEMICAL POT FEEDER.
- 13. LOCK SHUT OFF VALVE.
- 14. MOUNT EXPANSION TANK OF WALL. CONTRACTOR TO PROVIDE REQUIRED SUPPORT SYSTEM.

**Certificate of Authorization Epp Siepman Engineering Inc.** No. 4035


epp siepman engineering inc. mechanical & electrical engineers

303-100 Osborne St. South Winnipeg, MB R3L 1Y5 p 204.453.1080 ese@eppsiepman.com

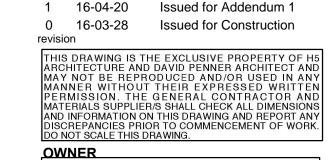



CITY OF WINNIPEG - PLANNING, PROPERTY
& DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION 3rd FLOOR - 65 GARRY ST., WPG, R3C 4K4

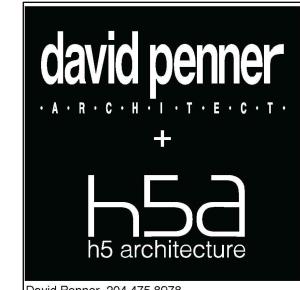

David Penner, 204.475.8978 Helio Rodrigues, 204.774.0012 120 Yale Avenue, Winnipeg, MB, R3M 0L7

**PROJECT** 

Windsor Park Library **ADDRESS** 1201 Archibald Street

DATE March 28, 2016

SCALE

hydronic schematic MY3.1