




EMERGENCY CALL SYSTEM EQUIPMENT LIST	
ITEM NO.	DESCRIPTION
1	1 DOME LIGHT C/W BUILT-IN BUZZER/HORN C/W TRANSLUCENT WHITE PLASTIC COVER MOUNTED ON WHITE ABS FLAME RETARDANT PLASTIC PANEL
2	120VAC/12-24VDC LOW VOLTAGE TRANSFORMER
3	1 PULL CORD STATION C/W WHITE ABS FLAME RETARDANT PLASTIC HOUSING C/W "EMERGENCY" IN BLACK LETTERS C/W RED "CALL PLACED" INDICATOR
4	ONE (1) 2/C-18AWG FT6/FT4 WIRING IN CONDUIT

- GENERAL NOTES**
- EMERGENCY CALL SYSTEM SHALL BE EQUAL TO ALPHA COMMUNICATIONS MODEL# EK117B.
 - CONFIRM ALL REQUIREMENTS AND WIRING TYPES WITH SYSTEM VENDOR PRIOR TO INSTALLATION.

- KEY NOTES**
- LOW VOLTAGE TRANSFORMER SHALL BE MOUNTED IN ACCESSIBLE CEILING SPACE NEAR WASHROOM DOOR. CONFIRM LOCATION ON SITE.

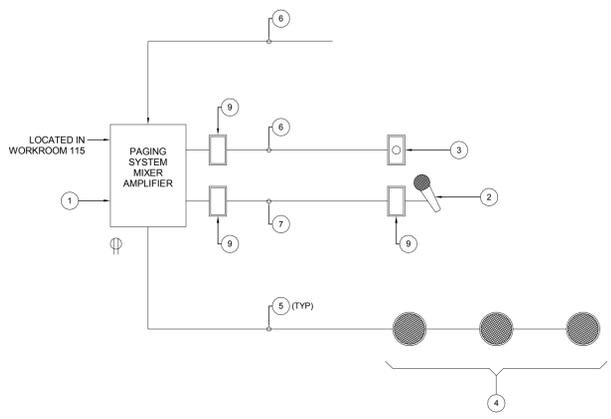


PAGING SYSTEM EQUIPMENT LIST	
ITEM NO.	DESCRIPTION
1	PAGING SYSTEM MIXER/AMPLIFIER
2	DESK MOUNTED PAGING MICROPHONE
3	REMOTE VOLUME CONTROL
4	PAGING SPEAKER
5	2/C #18AWG FT6/FT4 IN CONDUIT
6	3/C #18AWG FT6/FT4 IN CONDUIT
7	3/C #22AWG-SHIELDED FT6/FT4 IN CONDUIT
8	INPUT FROM AUDIO/MUSIC EQUIPMENT (NIC)
9	WALL INPUT/OUTPUT PATCH PLATE

PAGING SYSTEM ZONE LISTING	
ZONE	LOCATION
Z01	ALL CALL
Z02	MULTI-PURPOSE 102

- GENERAL NOTES**
- ALL WIRING SHALL BE INSTALLED WITHOUT JOINTS OR SPLICES FROM DEVICE TO DEVICE, OR TO THE HEAD-END EQUIPMENT.
 - FINISHES OF ALL SPEAKERS SHALL BE WHITE.
 - ALL EXPOSED WIRING SHALL BE WIRE IN CONDUIT.
 - PROVIDE PATCH CABLES AS REQUIRED. MINIMUM LENGTH SHALL BE 1825mm(6'-0").

2 EMERGENCY CALL SYSTEM RISER DIAGRAM
E5.2 SCALE: NTS


1 PAGING SYSTEM RISER DIAGRAM
E5.2 SCALE: NTS

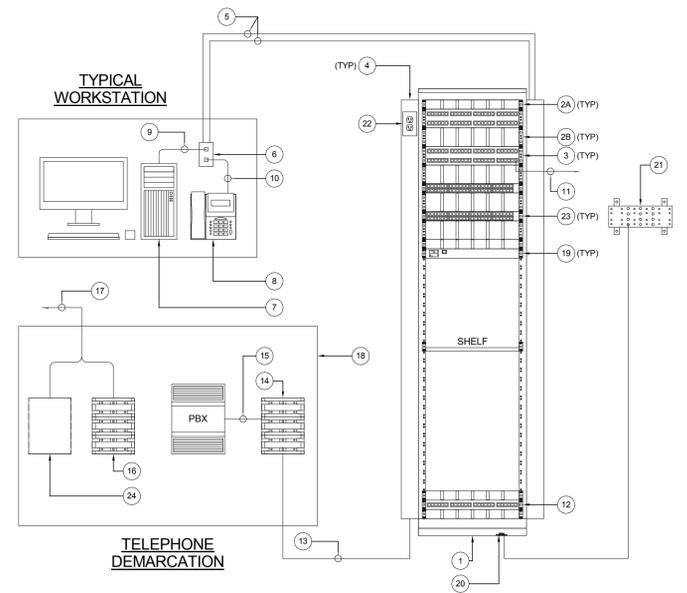

EQUIPMENT LIST	
1	45U 2135mm (84") 2-POST RELAY RACK
2A	1U HORIZONTAL WIRE MANAGEMENT
2B	2U HORIZONTAL WIRE MANAGEMENT
3	2U HORIZONTAL CABLING PATCH PANEL - 48 PORT
4	101mm (4") VERTICAL WIRE MANAGEMENT
5	WORKSTATION HORIZONTAL CABLING
6	COMMUNICATION OUTLET
7	COMPUTER - (NIC)
8	TELEPHONE - (NIC)
9	WORK AREA CORD - REFER TO SPECIFICATIONS
10	TELEPHONE LINE CORD - (NIC)
11	PATCH CORD - REFER TO SPECIFICATIONS
12	1U ANALOGUE PATCH PANEL - CAT 3, 24 PORT
13	CAT3 TO BIX FIELD - 1 x 25 PAIR
14	PBX OUTPUT - BIX WALL MOUNTED
15	CROSS CONNECT TO PBX - (NIC)
16	TELECOMMUNICATION SUPPLIER DEMARC - (NIC)
17	TELECOMMUNICATION BUILDING ENTRANCE CONDUIT
18	1200mm x 1200mm x 19mm (4'-0" x 4'-0" x 3/4") G1S PLYWOOD BACKBOARD. PAINT TO MATCH ROOM
19	1U RACK MOUNTED METERED PDU C/W 5-20R RCPT
20	GROUND LUG C/W MINIMUM #6 AWG GREEN GROUND TO TGB
21	TELECOMMUNICATION GROUNDING BUSS BAR (TGB). GROUND BUSS TO EIA/TIA607. 6mm (1/4") THICK BY 101mm (4") WIDE. MOUNTED ON STANDOFF INSULATORS C/W MINIMUM #3/0 AWG TO MAIN BUILDING GROUND
22	120V, NEMA 5-20R RCPT ON DEDICATED CIRCUIT MOUNTED TO REAR OF RACK
23	NETWORK SWITCH - (NIC)
24	TELECOMMUNICATION SUPPLIER FIBRE DEMARC - (NIC)

INTRUSION ALARM EQUIPMENT LIST	
1	MOTION DETECTOR
2	ALARM AUDIBLE NOTIFICATION DEVICE
3	DOOR CONTACT
4	ARMING STATION

INTRUSION ALARM ZONE LISTING		
ZONE	LOCATION	DEVICE
DC1	MAIN LIBRARY 101 - SW EXTERIOR DOOR	DOOR CONTACT
DC2	VESTIBULE 100 - EXTERIOR DOOR	DOOR CONTACTS
DC3	VESTIBULE 100 - INTERIOR DOOR	DOOR CONTACTS
DC4	MECH/ELECT 117 - EXTERIOR DOOR	DOOR CONTACT
WC1	WORKROOM 115 - OPERABLE WINDOWS	WINDOW CONTACT
MD1	MAIN LIBRARY 101 - #01	MOTION DETECTOR
MD2	MAIN LIBRARY 101 - #02	MOTION DETECTOR
MD3	MAIN LIBRARY 101 - #03	MOTION DETECTOR
MD4	MAIN LIBRARY 101 - #04	MOTION DETECTOR
MD5	MULTI-PURPOSE 102	MOTION DETECTOR
MD6	VESTIBULE 100	MOTION DETECTOR
MD7	WORKROOM 115	MOTION DETECTOR
MD8	STAFFROOM 116	MOTION DETECTOR
MD9	M & E ROOM 117	MOTION DETECTOR
HW1	SUMP PUMPS (P-3, P-4) DUPLEX CONTROLLER OUTPUT	HIGH WATER
BF1	BOILER B-1 ALARM SENSOR BOILER CONTROL PANEL OUTPUT	FAILURE
BF2	BOILER B-2 ALARM SENSOR BOILER CONTROL PANEL OUTPUT	FAILURE

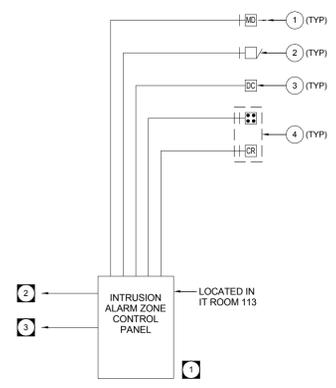

- GENERAL NOTES**
- INTRUSION ALARM SYSTEM SHALL BE BASED ON BOSCH B SERIES INTRUSION SYSTEM.
 - ALL WIRING SHALL BE RUN IN CONDUIT UNLESS NOTED OTHERWISE. UTILIZE J-HOOKS IN ACCESSIBLE CEILING SPACE ONLY.
 - DAISY CHAINING OF DEVICES NOT PERMITTED. ALL DEVICES SHALL BE HOME RUN TO THE HEAD END LOCATION.
 - ALL WIRING SHALL BE FT6/FT4 IN CONDUIT.

4 COMMUNICATIONS RISER DIAGRAM
E5.2 SCALE: NTS

3 INTRUSION ALARM RISER DIAGRAM
E5.2 SCALE: NTS

- KEY NOTES**
- INTRUSION SYSTEM SHALL BE PROGRAMMED/PARTITIONED SUCH THAT M & E 117 CAN BE ARMED/DISARMED INDEPENDENT OF THE REMAINING BUILDING.
 - PROVIDE AN OUTPUT (DRY CONTACT) TO LIGHTING CONTROL RELAYS TO OVERRIDE-OFF LIGHTING WITHIN MAIN LIBRARY 101 ONLY.
 - MONITORING OF INTRUSION ALARM SYSTEM SHALL BE DONE BY CITY OF WINNIPEG CENTRAL MONITORING STATION.

epp siepman engineering inc.
mechanical & electrical engineers
303-100 Osborne St. South
Winnipeg, MB
R3L 1Y5
p 204-453-1080
ese@eppsiepman.com

0 16-03-31 Issued for Construction
revision

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF HIS ARCHITECTURE AND DAVID PENNER ARCHITECT AND MAY NOT BE REPRODUCED AND/OR USED IN ANY MANNER WITHOUT THEIR EXPRESSED WRITTEN PERMISSION. THE GENERAL CONTRACTOR AND MATERIALS SUPPLIERS SHALL CHECK ALL DIMENSIONS AND INFORMATION ON THIS DRAWING AND REPORT ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK. DO NOT SCALE THIS DRAWING.

OWNER
Winnipeg
CITY OF WINNIPEG - PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION
3rd FLOOR - 65 GARRY ST., WPG, R3C 4K4



David Penner, 204.475.8978
Hello Rodrigues, 204.774.0012
120 Yale Avenue, Winnipeg, MB, R3M 0L7

PROJECT
Windsor Park Library
ADDRESS
1201 Archibald Street

DATE
February 28, 2016

SCALE
12" = 1'-0"

miscellaneous
riser diagrams
E5.2