



## 3. SUITABLE FOR WALL OR FLOOR SUPPORTED PIPE

- T316 SS ANCHORS

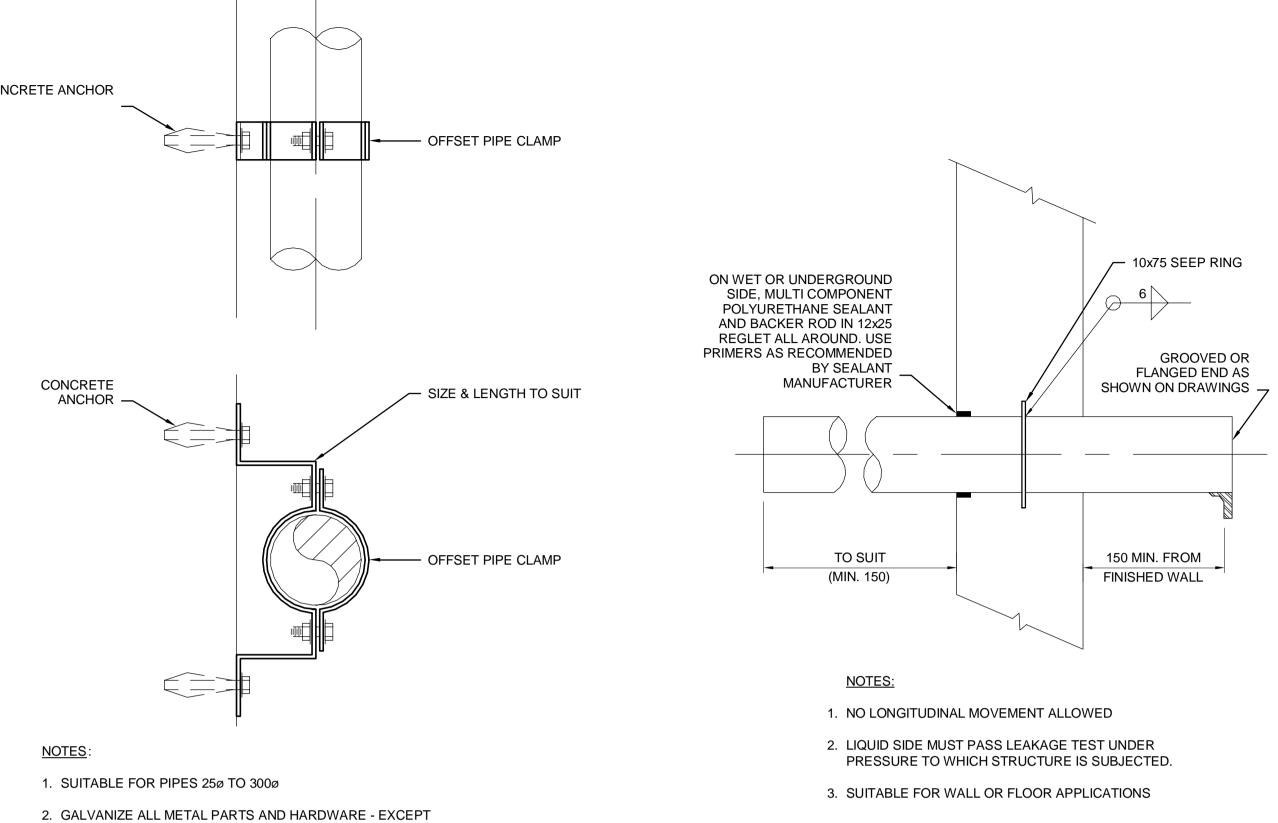

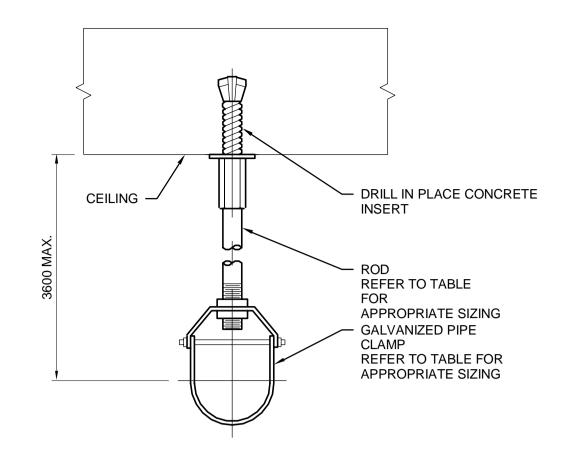

ROD SIZE

(mm)

9.5

9.5

12.7

15.9

19.1

19.1

22.2

22.2

25.4

25.4

25.4

31.8

31.8

PIPE SUPPORT DETAIL

SCALE: 1 : 1

MAX LOAD

(kg)

331

331

612

648

880

907

1632

1723 1904

2086

2176

2176

2176

PIPE SIZE

(mm)

25

50

75 100

150

200

250

300 350

400

450


500

600

BP-005

CONCRETE ANCHOR



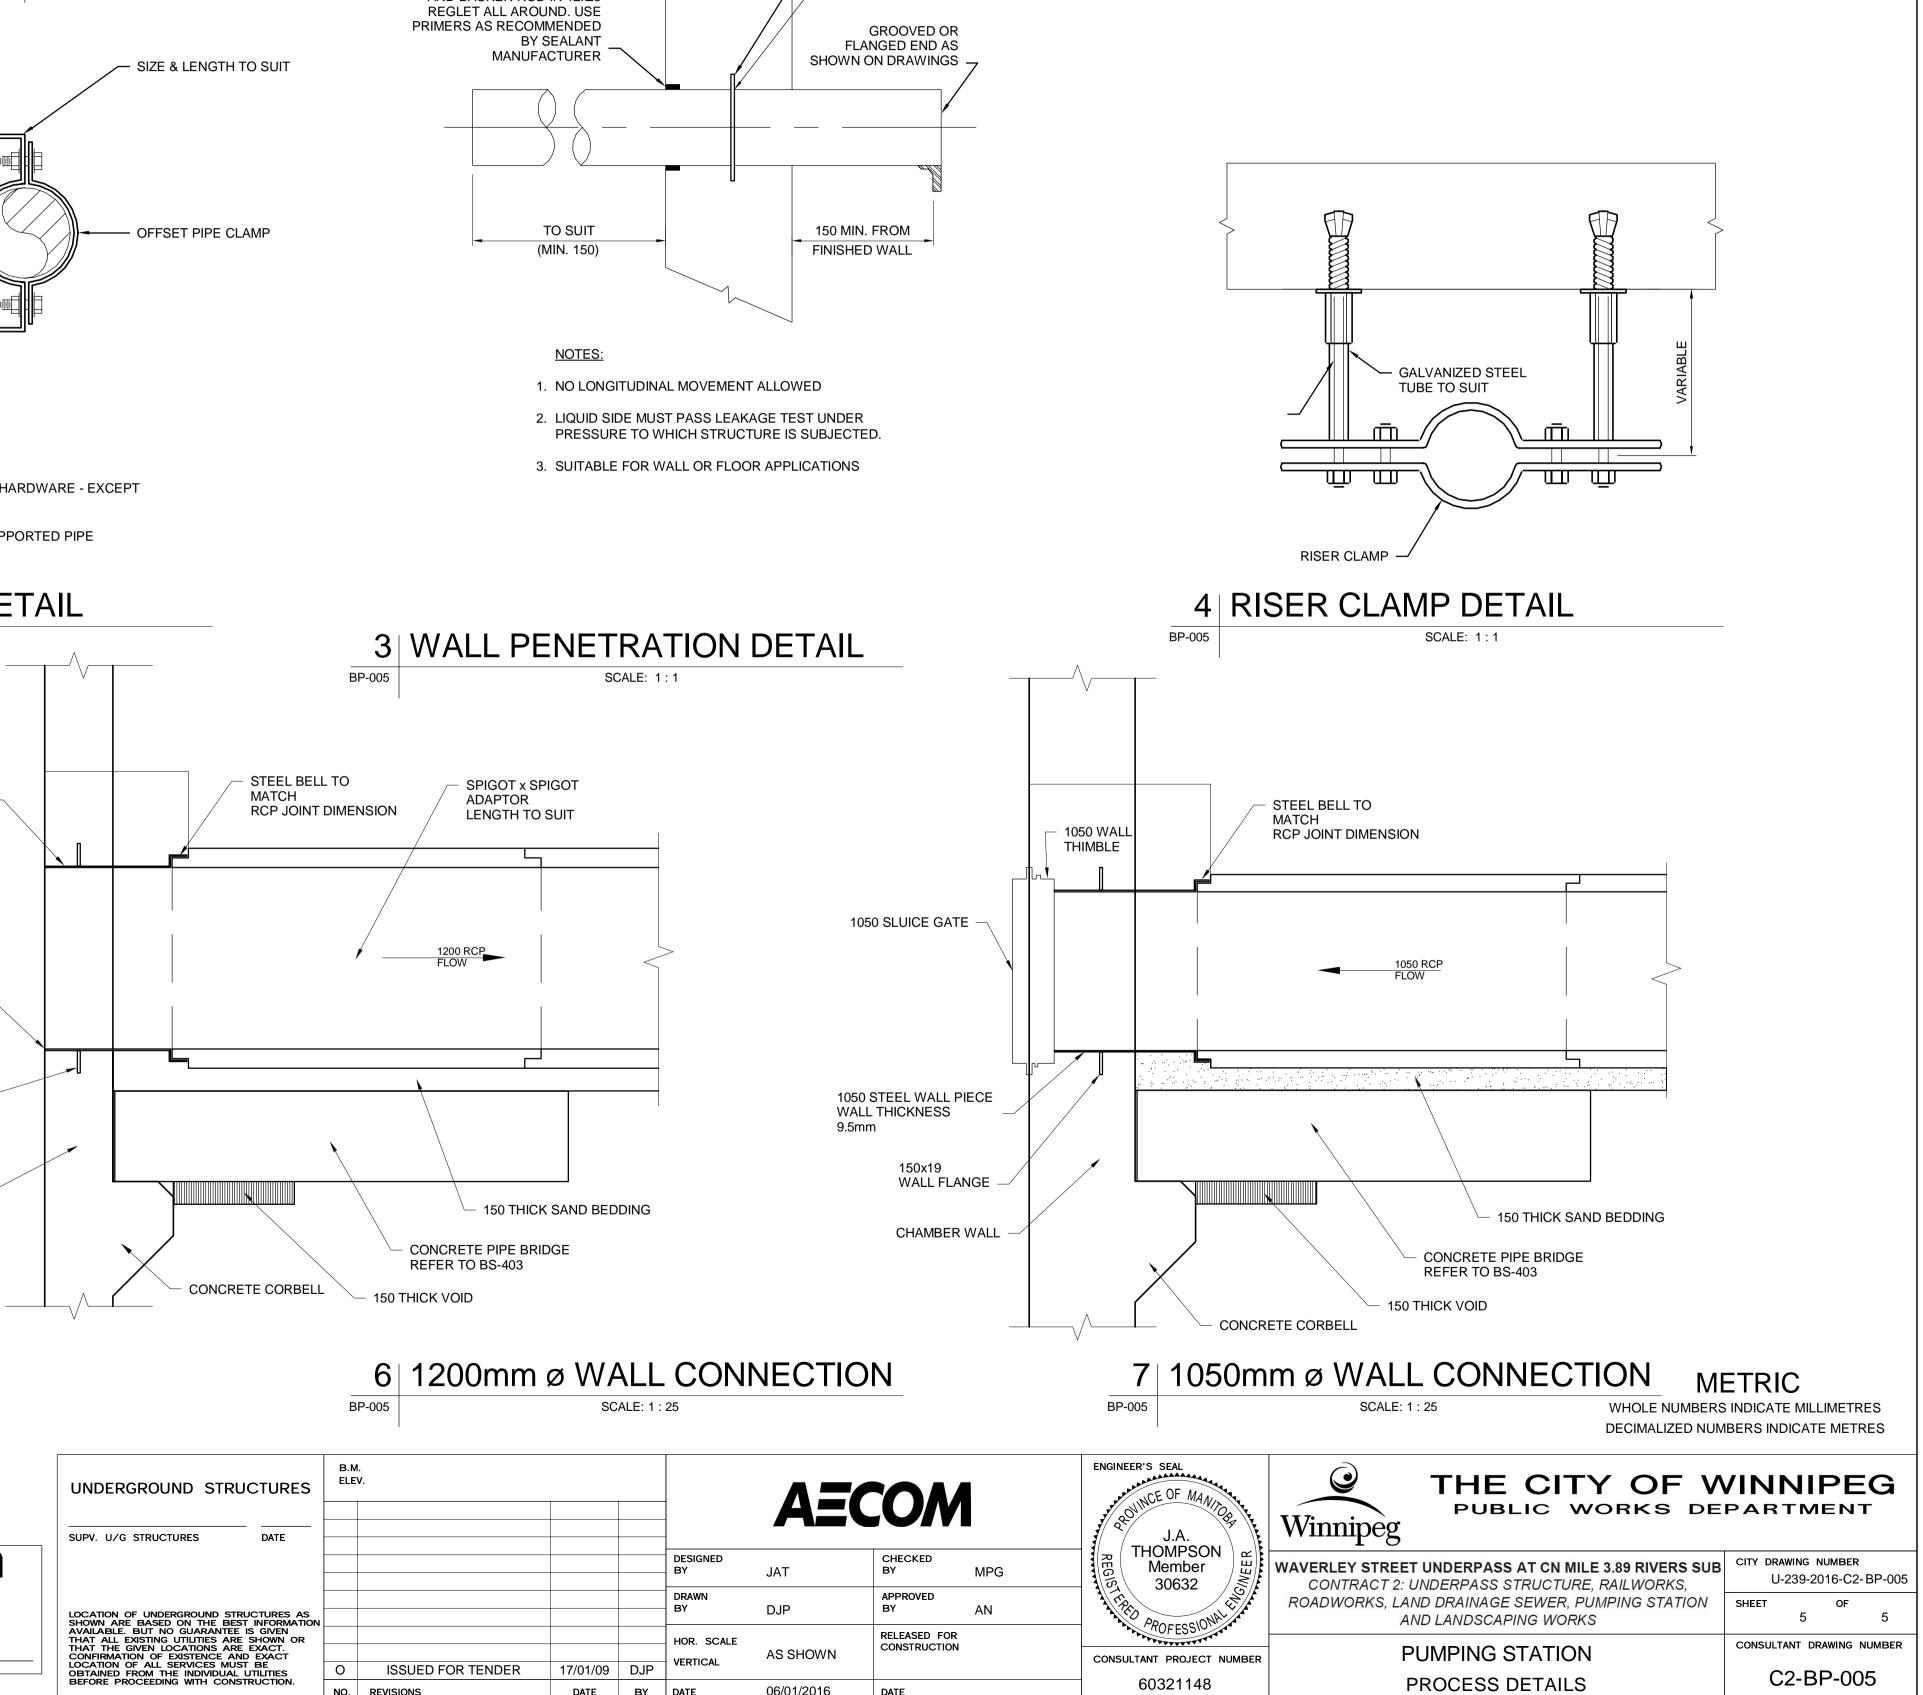

UNDERGROUND STRUCTURES	B.M. ELEV.				AECOM				ENGINEER'S
SUPV. U/G STRUCTURES DATE					-				and the second s
					DESIGNED BY	JAT	CHECKED BY	MPG	
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.					DRAWN BY	DJP	APPROVED BY	AN	
					HOR. SCALE VERTICAL DATE	AS SHOWN	RELEASED FOR CONSTRUCTION DATE		CONSULTA
	O NO.	ISSUED FOR TENDER	17/01/09 DATE	DJP BY		06/01/2016			6