



± 914 mm ELEVATION  
1:20

**STAGE 2**


1. INSTALL TEMPORARY BRACING RING AT 914 mm ABOVE EXISTING FLOOR ELEVATION.
2. INSTALL TEMPORARY BRACING BEAMS W200 x 27 AT LOCATIONS SHOWN.
3. ALL TEMPORARY STRUCTURES TO BE REMOVED AFTER CONCRETE SLAB HAS ACHIEVED 75% OF THE DESIGN STRENGTH.

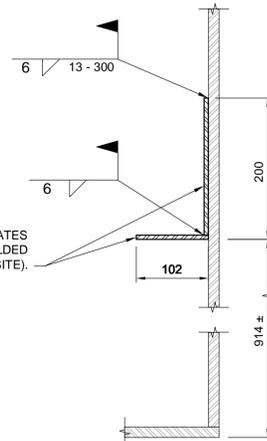


**D SECTION**  
1:5

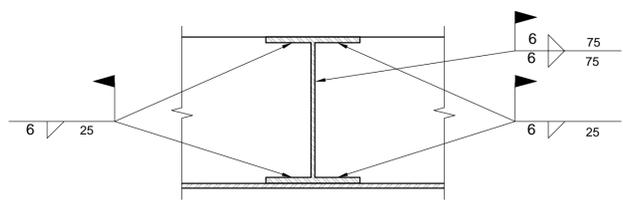

**E SECTION**  
1:5

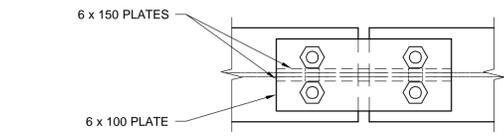


**PLAN**

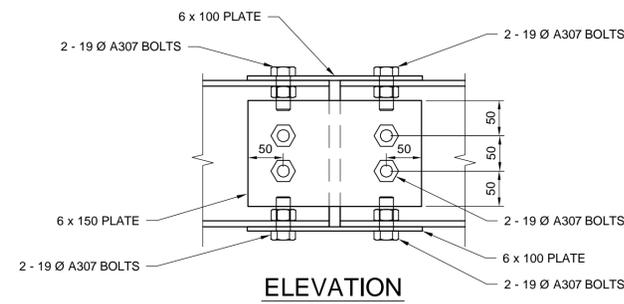

**ELEVATION**


**TYPICAL W200 FIELD SPLICE**  
1:5

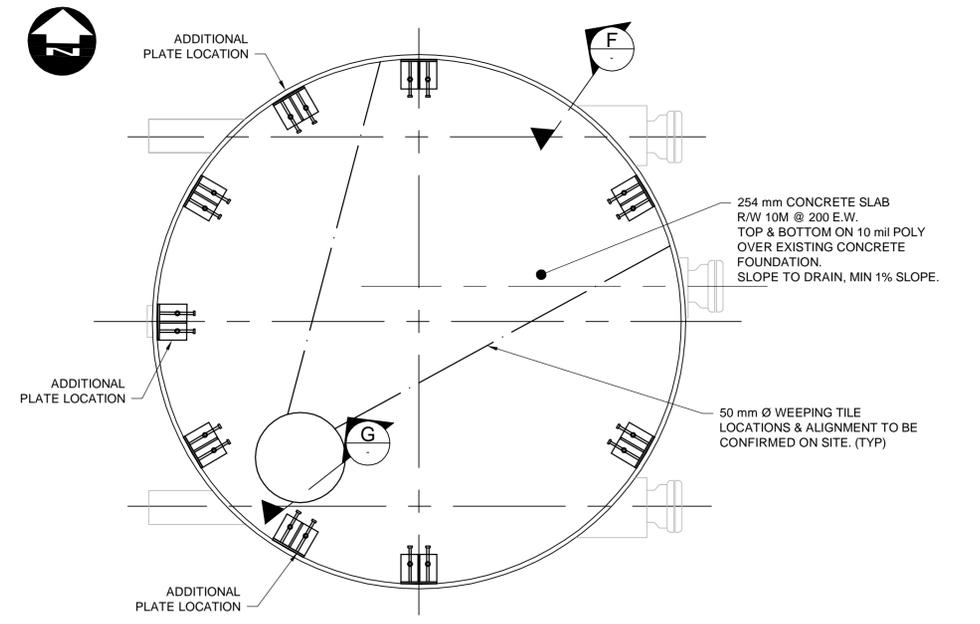


**FLOOR PLAN**  
1:20

**STAGE 3**

1. REMOVE THE REST OF EXISTING STEEL FLOOR
2. INSTALL ADDITIONAL BENT PLATES AT LOCATIONS SHOWN

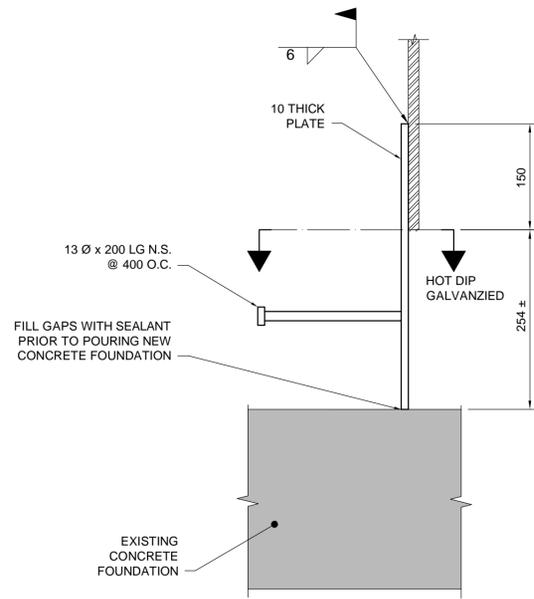

**F SECTION**  
1:5

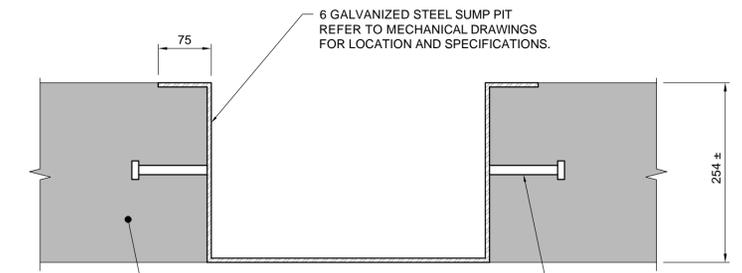

**G SECTION**  
1:5

B.M. ELEV.	DESIGNED BY	NR		ENGINEER'S SEAL		
	DRAWN BY	DJB		CONSULTANT PROJECT NO.		
	CHECKED BY	-	RELEASED FOR CONSTRUCTION	DATE		BURROWS AVENUE PUMPING STATION UPGRADES STRUCTURAL SLAB REHABILITATION STAGES 2 & 3
	APPROVED BY	-				
0	ISSUED FOR BID OP. 803-2016	16-09-14	NR			CITY DRAWING NUMBER 1-01211-S0002-001 SHEET 5 OF 16
NO.	REVISIONS	DATE	BY	DATE		S-2