

GRILLE AND DIFFUSER SCHEDULE					
TAG	DESCRIPTION	MANUFACTURER	MODEL	REMARKS	
S-1	LINEAR BAR GRILLE	E.H. PRICE	LBP16B	COLOUR B12, SIZE REFER TO DRAWING	

FAN SCHEDULE (PROVIDED BY GENERAL CONTRACTOR)						
TAG	MANUFACTURER	MODEL	AIR FLOW cfm @ 0.0"	AIR FLOW cfm @ 0.3"	AMPS	REMARKS
RH-1	VENT-A-HOOD	900cfm B200 DUAL & B100 SINGLE	900	655	6	10" DUCT, VP562 TRANSITION
NOTES: 1. INTERLOCK RH-1 WITH MAU-1						

MINI MAKE UP AIR UNIT SCHEDULE						
TAG	MANUFACTURER	MODEL	AIR FLOW cfm	SP in	MAX kW	REMARKS
MAU-1	THERMOLEC	FER-10-10	300	0.2	10	C/W FILTER AND ELECTRONIC CONTROLLER BUILT IN DAMPER, ELECTRONIC TEMPERATURE SENSOR
NOTES: 1. INT	NOTES: 1. INTERLOCK RH-1 WITH MAU-1					

PLUMBING FIXTURE CONNECTION SIZES					
TAG	SANITARY IN	DCW IN	DHW IN	TRAP IN	
SINK	1.5	0.5	0.5	1.5	

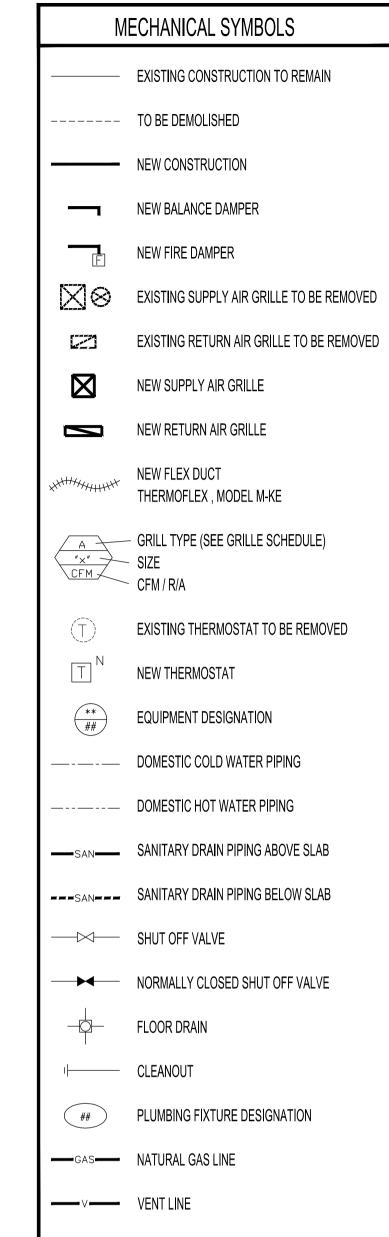

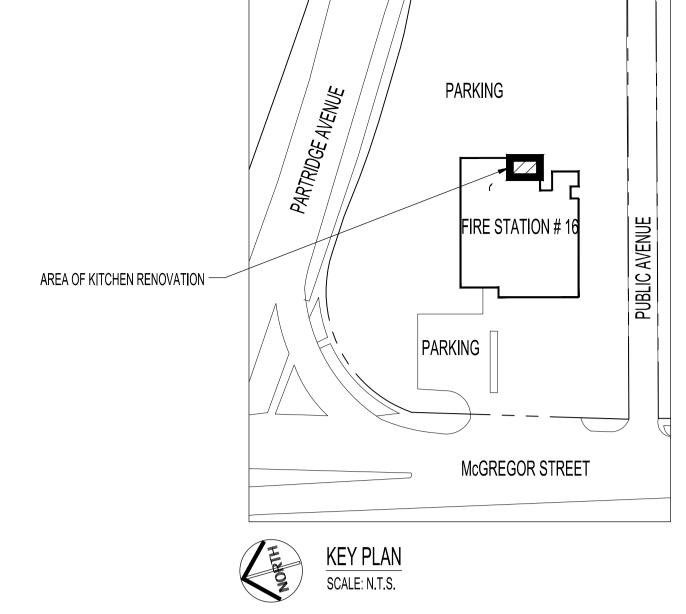



THESE DRAWINGS SHALL NOT BE SCALED.

THIS DRAWING IS DIAGRAMMATIC ONLY. CONTRACTOR TO COORDINATE EXACT LOCATIONS OF AND ROUTING ON SITE WITH ALL NEW AND EXISTING SYSTEM.

THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY ONESELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.

THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN

ON DRAWINGS.

ALL OPENINGS THROUGH FIRE ASSEMBLIES ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION, AND

PROVIDE A SMOKE-TIGHT BARRIER.

ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH

NEW DUCT SHALL BE CONSTRUCTED AS RECOMMENDED BY SMACNA.

MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.

THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.

PLUMBING INSTALLATION SHALL CONFORM TO NATIONAL PLUMBING CODE OF CANADA.


THE CONTRACTOR IS RESPONSIBLE FOR INSTALLING RISERS, SWING JOINTS AND DEEP CUP ESCUTCHEONS AS REQUIRED.


ELECTRICAL WIRING SHALL BE PERFORMED BY A QUALIFIED ELECTRICAL SUBTRADE.

PROVIDE MILCOR ACCESS DOORS IN DRYWALL CEILINGS AND WALLS FOR ACCESS TO MECHANICAL EQUIPMENT. MINIMUM SIZE 24" X 18".

THE MECHANICAL CONTRACTOR SHALL ARRANGE WITH MANITOBA HYDRO GAS DIVISION FOR REVISION TO GAS SERVICE INCLUDING PRESSURE REGULATOR. THE COST OF THIS SERVICE SHALL BE INCLUDED IN THE COST OF THIS CONTRACT.

MECHANICAL DRAWING LIST				
SHEET No:	SHEET TITLE			
M1	KEY PLAN, MECHANICAL SYMBOLS AND SCHEDULES			
M2	PARTIAL MAIN FLOOR PLAN - MECHANICAL RENOVATION			
M3	MECHANICAL SPECIFICATION			

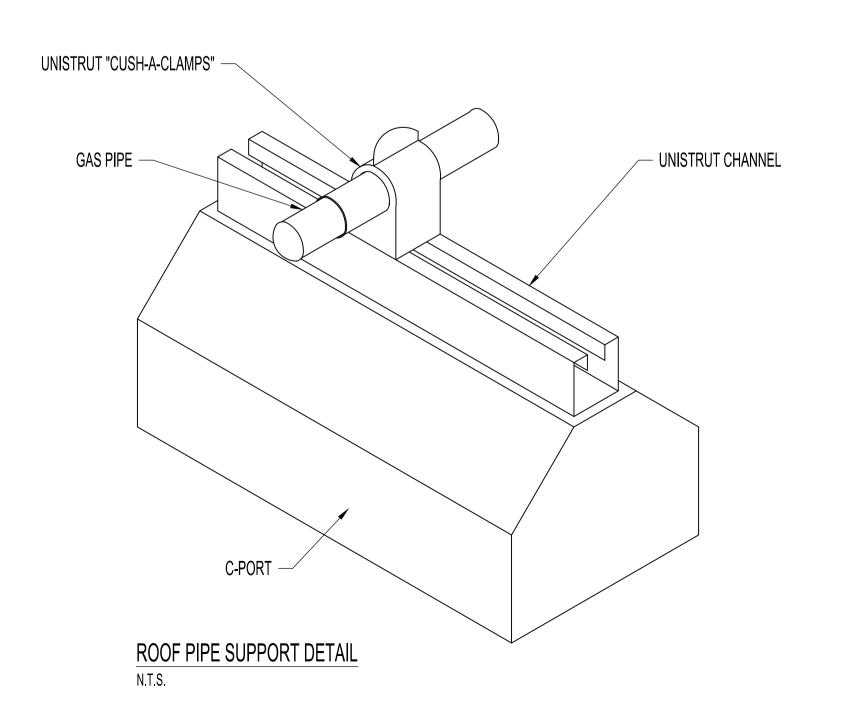





DRAWN CHECKED XYW DESIGNED XYW APPROVED XYW

DATE 2017.11.15 USER
APPROVAL



THE CITY OF WINNIPEG
PLANNING, PROPERTY AND
DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION
3-65 GARRY STREET, R3C 4K4

WINNIPEG FIRE PARAMEDIC SERVICES
FIRE STATION #16

1001 MCGREGOR STREET

1001 MCGREGOR STREET BID OPP: 1013-2017

SHEET TITLE

KEY PLAN, MECHANICAL SYMBOLS AND SCHEDULES

SCALE PROJECT No: SHEET No: M1

DRAWING SHEET SIZE: A1 (841mm x 594mm) PLOT 1:1