



**NOTE:**

Contractor shall supply and install all work necessary to mechanize existing water well and connect to new washrooms for a fully functioning water supply system. Well is located north and west of the parking lot; Contractor to SITE VERIFY exact location in relation to new washroom prior to tender.

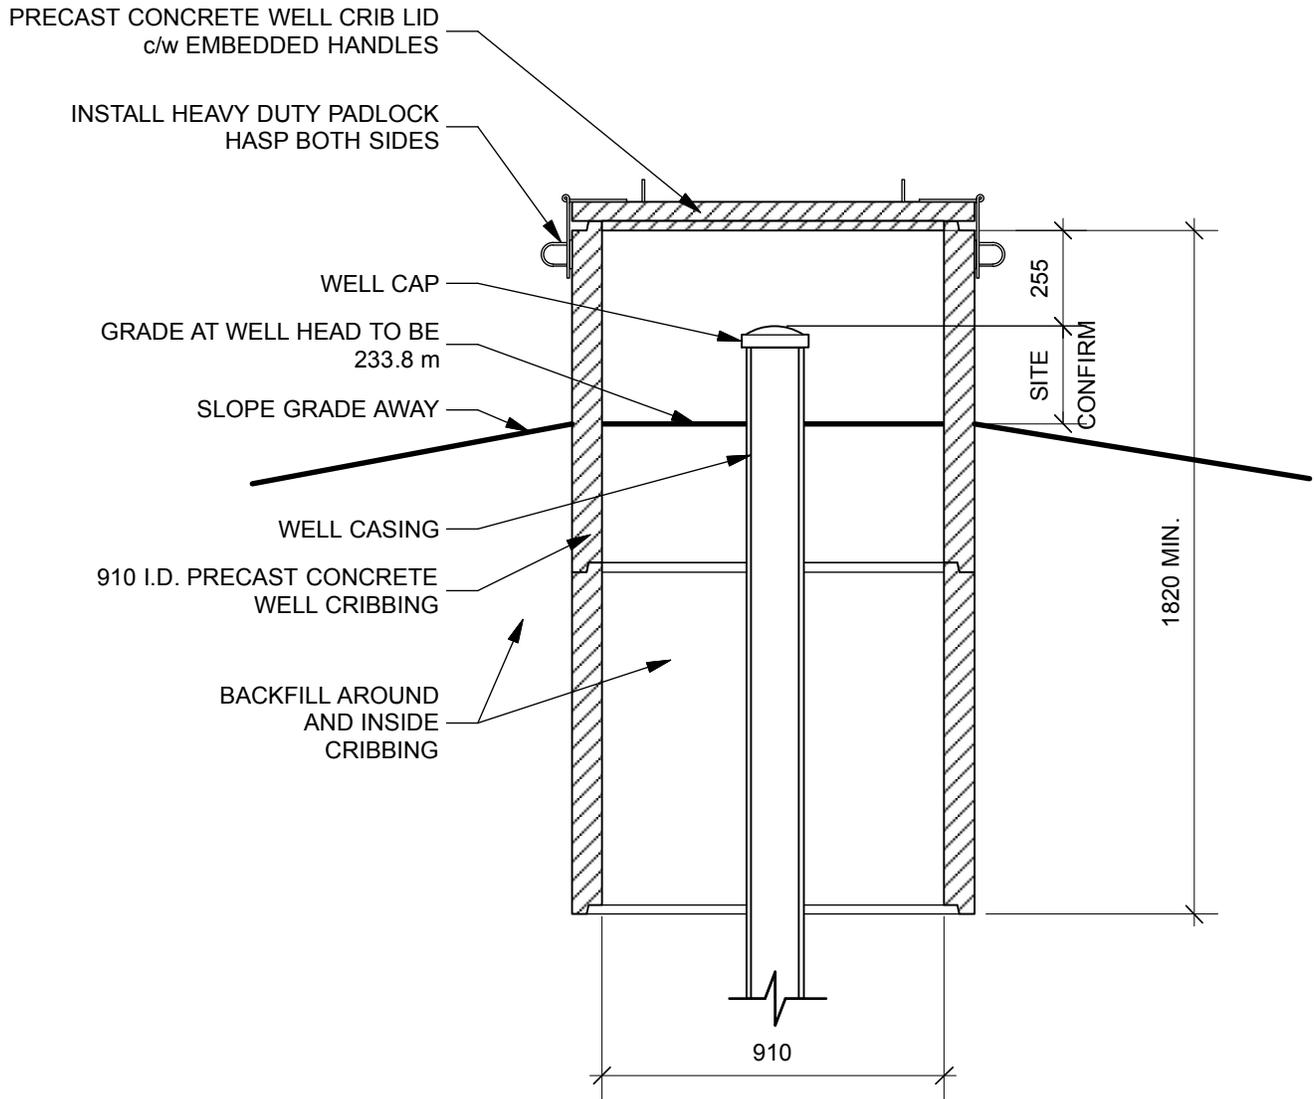

**NOTE:**

Provide precast concrete well house to protect well head after existing well has been mechanized and connected to the washrooms. Submit shop drawings for review. Please note grade to be built-up around well head to elevation indicated, as per Manitoba Groundwater Management requirements. See Mechanical and Electrical.

<p>Northern Sky Architecture Inc.</p>  <p>100 - 128 James Avenue Winnipeg, Manitoba, Canada R3B 0N8 contact@nscal.ca Fax 204.956.7979 204.943.6767</p>	<p><b>Well House</b></p>	<p>drawn by: kbb</p> <p>scale: 1:20</p>
	<p><b>La Barriere Park Washroom Replacement</b></p> <p>4403 Waverley Street, Manitoba</p>	<p>reviewed by: dko</p> <p>date: Jan. 16, 2018</p>
	<p>bid opportunity no.: 337-2017</p>	<p>drawing no.: <b>ADD. 1.1</b></p>