


FIELD

CONTROL PANEL CP-M801

FIELD TERMINALS

PLC SECTION

BMX DAI 1604
RACK 0, SLOT 2

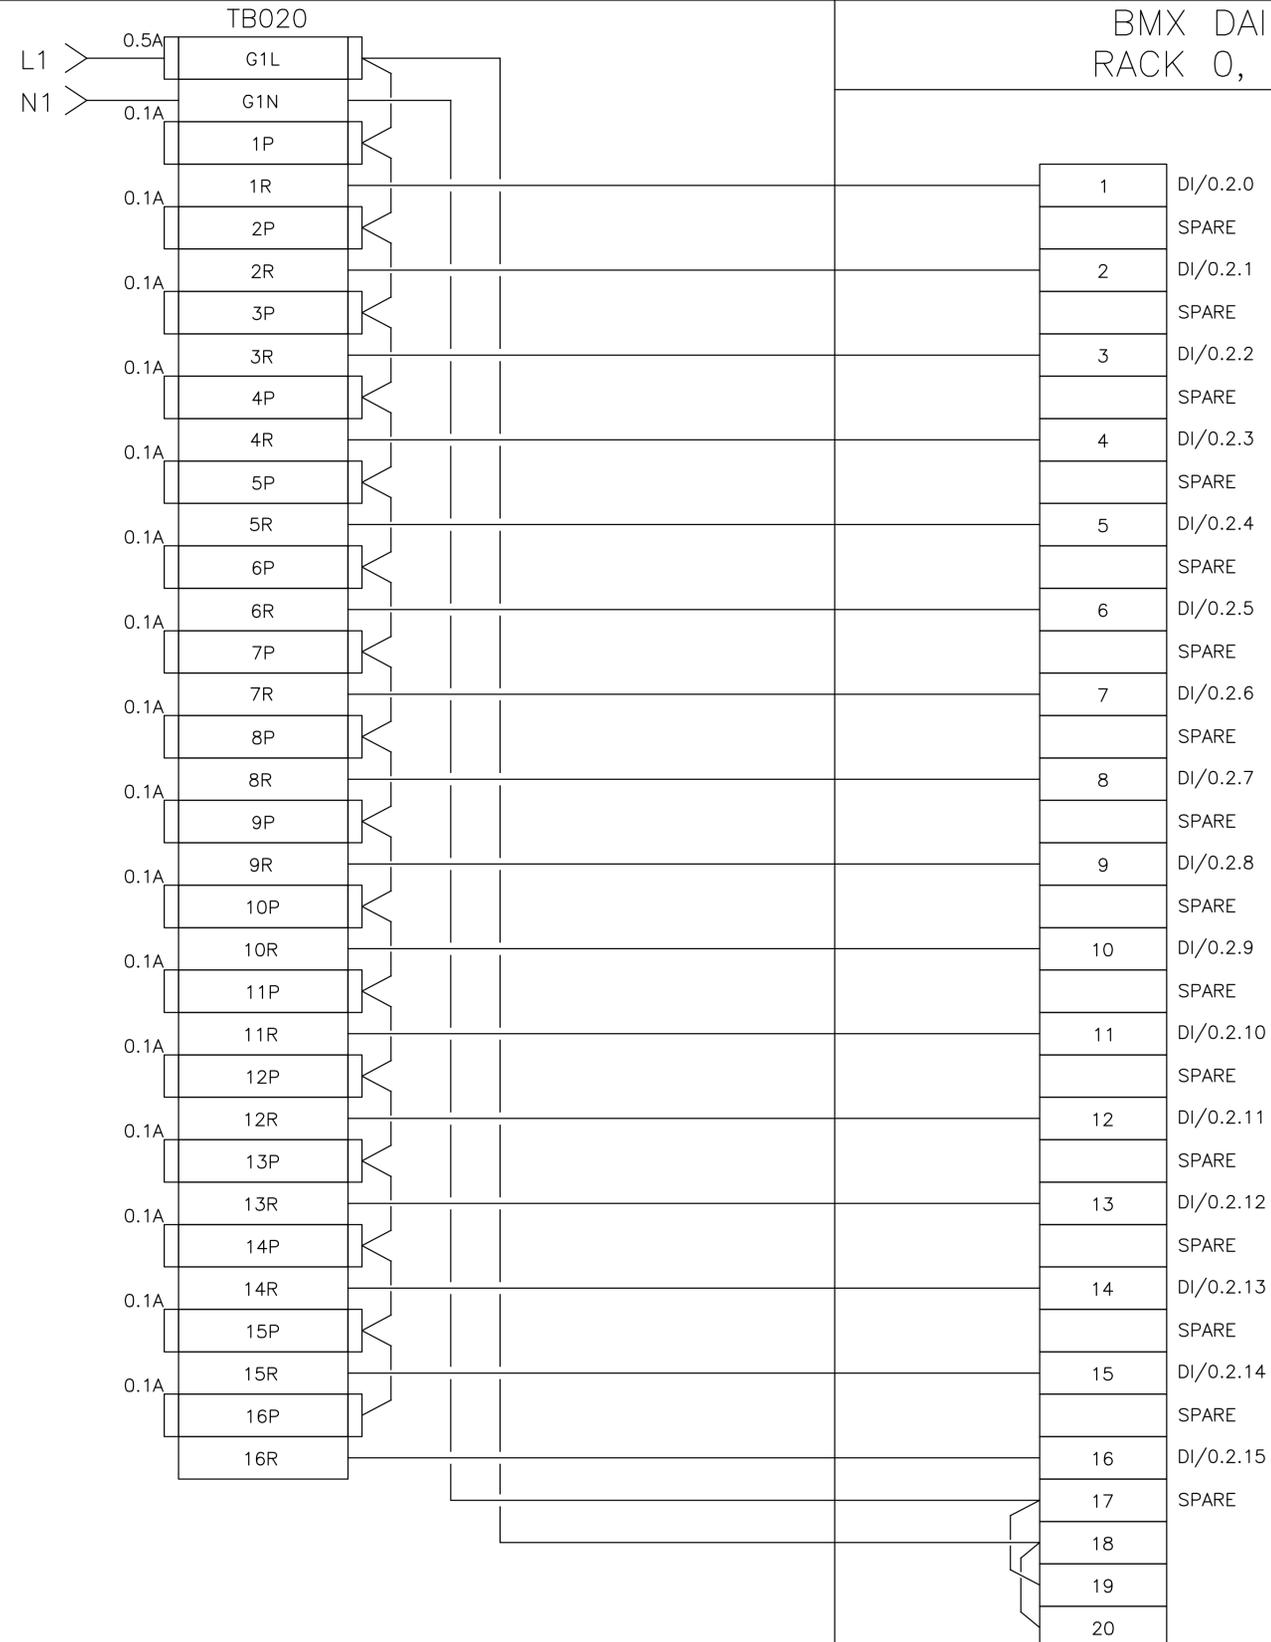

B.M. ELEV.	DESIGNED BY BLM
	DRAWN BY MS
	CHECKED BY -
	APPROVED BY -
	HDR. SCALE
0	VERTICAL
NO.	REVISIONS
	DATE
	BY
	DATE

RELEASED FOR CONSTRUCTION
DATE



ENGINEER'S SEAL
CONSULTANT PROJECT NO. 163526

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT
NEWPCC MAIN BUILDING - HVAC REPLACEMENT
CONTROL PANEL CP-M801
RACK 0, SLOT 2, WIRING DIAGRAM

CITY DRAWING NUMBER 1-0101M-A0044-001
SHEET 14 OF 21

IL-03