




FIELD

CONTROL PANEL CP-M801

FIELD TERMINALS

PLC SECTION

BMX AMI 0410
RACK 0, SLOT 4

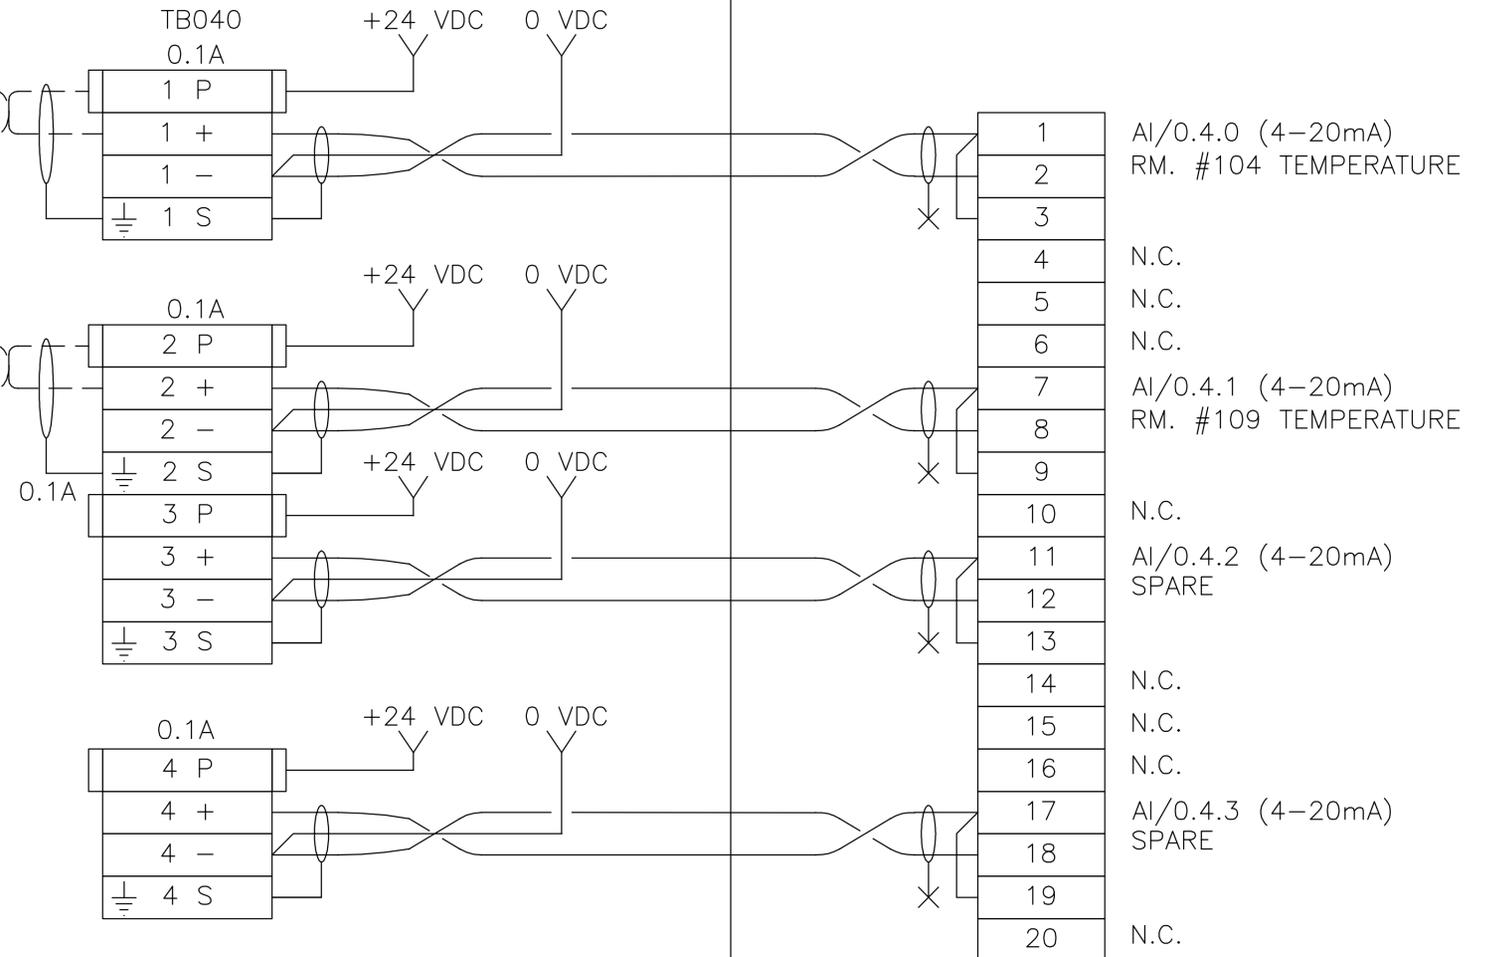

| | | | | | |
|--|-------------------|----------|------|-----------------------------------|---|
| B.M. ELEV. | DESIGNED BY | BLM | | ENGINEER'S SEAL | |
| | DRAWN BY | MS | | | |
| | CHECKED BY | - | | | |
| | APPROVED BY | - | | | |
| 0 NO. REVISIONS | ISSUED FOR TENDER | 17/04/13 | BLM | RELEASED FOR CONSTRUCTION DATE | CONSULTANT PROJECT NO. 163526 |
| | DATE | DATE | DATE | | |
| NORTH END SEWAGE TREATMENT PLANT NEWPCC MAIN BUILDING - HVAC REPLACEMENT CONTROL PANEL CP-M801 RACK 0, SLOT 4, WIRING DIAGRAM | | | | | CITY DRAWING NUMBER 1-0101M-A0046-001 SHEET 16 OF 21 IL-05 |