



FOR OPENINGS LESS THAN 12" [305mm] BY 12" [305mm]:

INSTALL 20 GA. STEEL SHEET OVER THE OPENING. EXTEND BEYOND THE PERIMETER OF THE OPENING 6" [152mm] MIN AND SECURE WITH DECK FASTENERS 6" [152mm] OC.

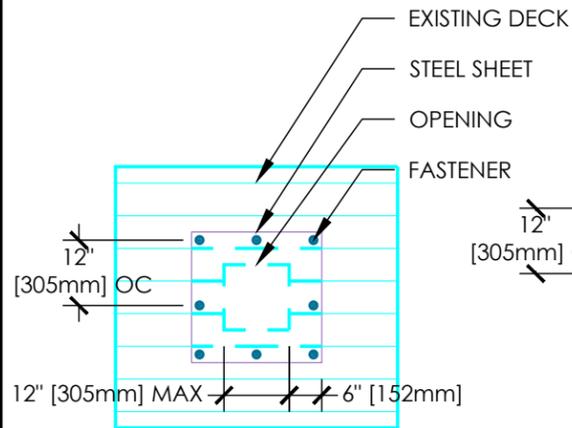


FOR OPENINGS LESS THAN 24" [610mm] BY 24" [610mm]:

INSTALL NEW STEEL DECKING TO MATCH THE EXISTING OVER THE OPENING. EXTEND BEYOND THE PERIMETER OF THE OPENING 6" [152mm] MIN AND SECURE WITH DECK FASTENERS 6" [152mm] OC. DECKING MUST SPAN BETWEEN 2 STRUCTURAL SUPPORTS.

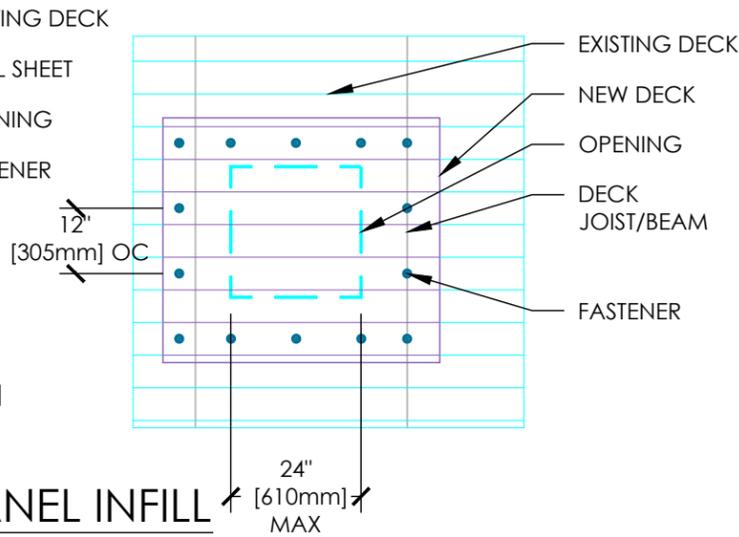


FOR OPENINGS GREATER THAN 24" [610mm] BY 24" [610mm]:

INSTALL NEW STEEL DECKING TO MATCH THE EXISTING OVER THE OPENING. EXTEND BEYOND THE PERIMETER OF THE OPENING 6" [152mm] MIN AND SECURE WITH DECK FASTENERS 6" [152mm] OC. DECKING MUST SPAN BETWEEN 3 STRUCTURAL SUPPORTS.

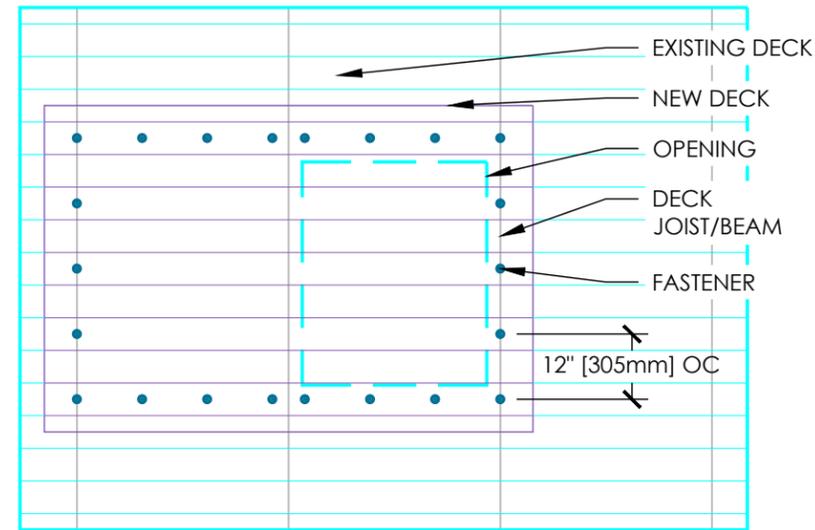


1 METAL PANEL INFILL
NTS

A=10' [3048mm] MAX FOR 1.5" [38mm] Ø PIPE
6' [1829mm] MAX FOR 3" [76mm] Ø PIPE

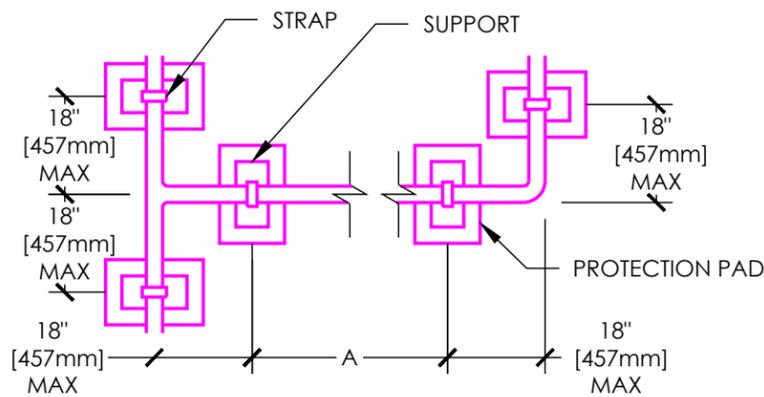

2 SUPPORT LAYOUT
NTS

FOR CORRODED DECKING:
SCRAPE ALL LOOSE RUST FROM THE DECK.
APPLY RUST INHIBITER/PRIMER TO THE AFFECTED AREA.
EXTEND BEYOND THE AREA 6" [152mm] ON ALL SIDES.

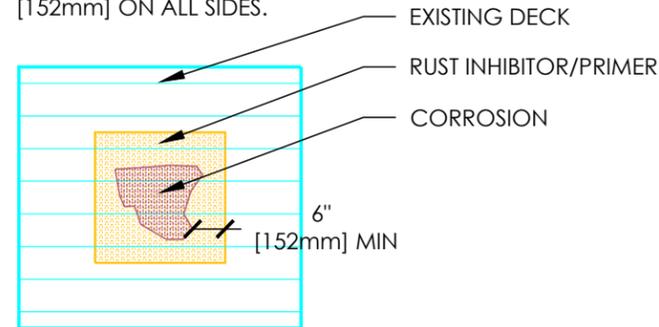

3 METAL PANEL REPAIR
NTS

RMIS ENGINEERING



389 MAXWELL CRESCENT
Regina, SK S4N 5X9
www.rmiseng.ca
Phone 306.352.4606
Fax 306.352.4607



WESTRIDGE
COMMUNITY CENTRE
C.13.MB.35-18.04.03

3 MARSHALL CRESCENT
WINNIPEG, MB R3T 4C3

CITY OF WINNIPEG

4TH FLOOR - 185 KING STREET
WINNIPEG, MB R3B 1J1

| No. | DATE | DESCRIPTION |
|-----|------|-------------|
| | | |
| | | |
| | | |
| | | |
| | | |

DESIGNED BY SMC 04/17/2018
DRAWN BY SED 04/17/2018
REVIEWED BY SMC 04/17/2018

METAL PANEL REPAIR
& GAS LINE DETAILS

A 4.01