


KEY NOTES

- 1 EXISTING AHU SERVING BASEMENT AREAS TO BE REMOVED COMPLETE WITH PIPING, CONTROLS, DUCTWORK AND POWER.
- 2 EXISTING AHU SERVING AUDITORIUM AREA TO BE REMOVED COMPLETE WITH PIPING, CONTROLS, DUCTWORK AND POWER.
- 3 EXISTING AUDITORIUM SUPPLY DUCTWORK WITHIN CRAWLSPACE TO REMAIN.
- 4 EXISTING LOBBY FAN COIL TO BE REMOVED COMPLETE WITH DUCTWORK, CONTROLS AND POWER.
- 5 EXISTING AHU SERVING POOL AREA TO BE REMOVED COMPLETE WITH PIPING, CONTROLS, DUCTWORK AND POWER.
- 6 EXISTING DUCTWORK WITHIN CRAWLSPACE SERVING POOL AREA TO REMAIN.
- 7 EXISTING VENTILATION AND COMBUSTION AIR DUCTWORK SERVING BOILER ROOM TO BE REMOVED ENTIRELY.
- 8 EXISTING BREACHING AND CHIMNEY SERVING BOILER SYSTEM TO BE REMOVED ENTIRELY.
- 9 DEMOLISH EXHAUST DUCTWORK AND CAP AT THIS LOCATION.


Rev. No. Date Revision Notes
 0 19-11-06 Issued for Construction

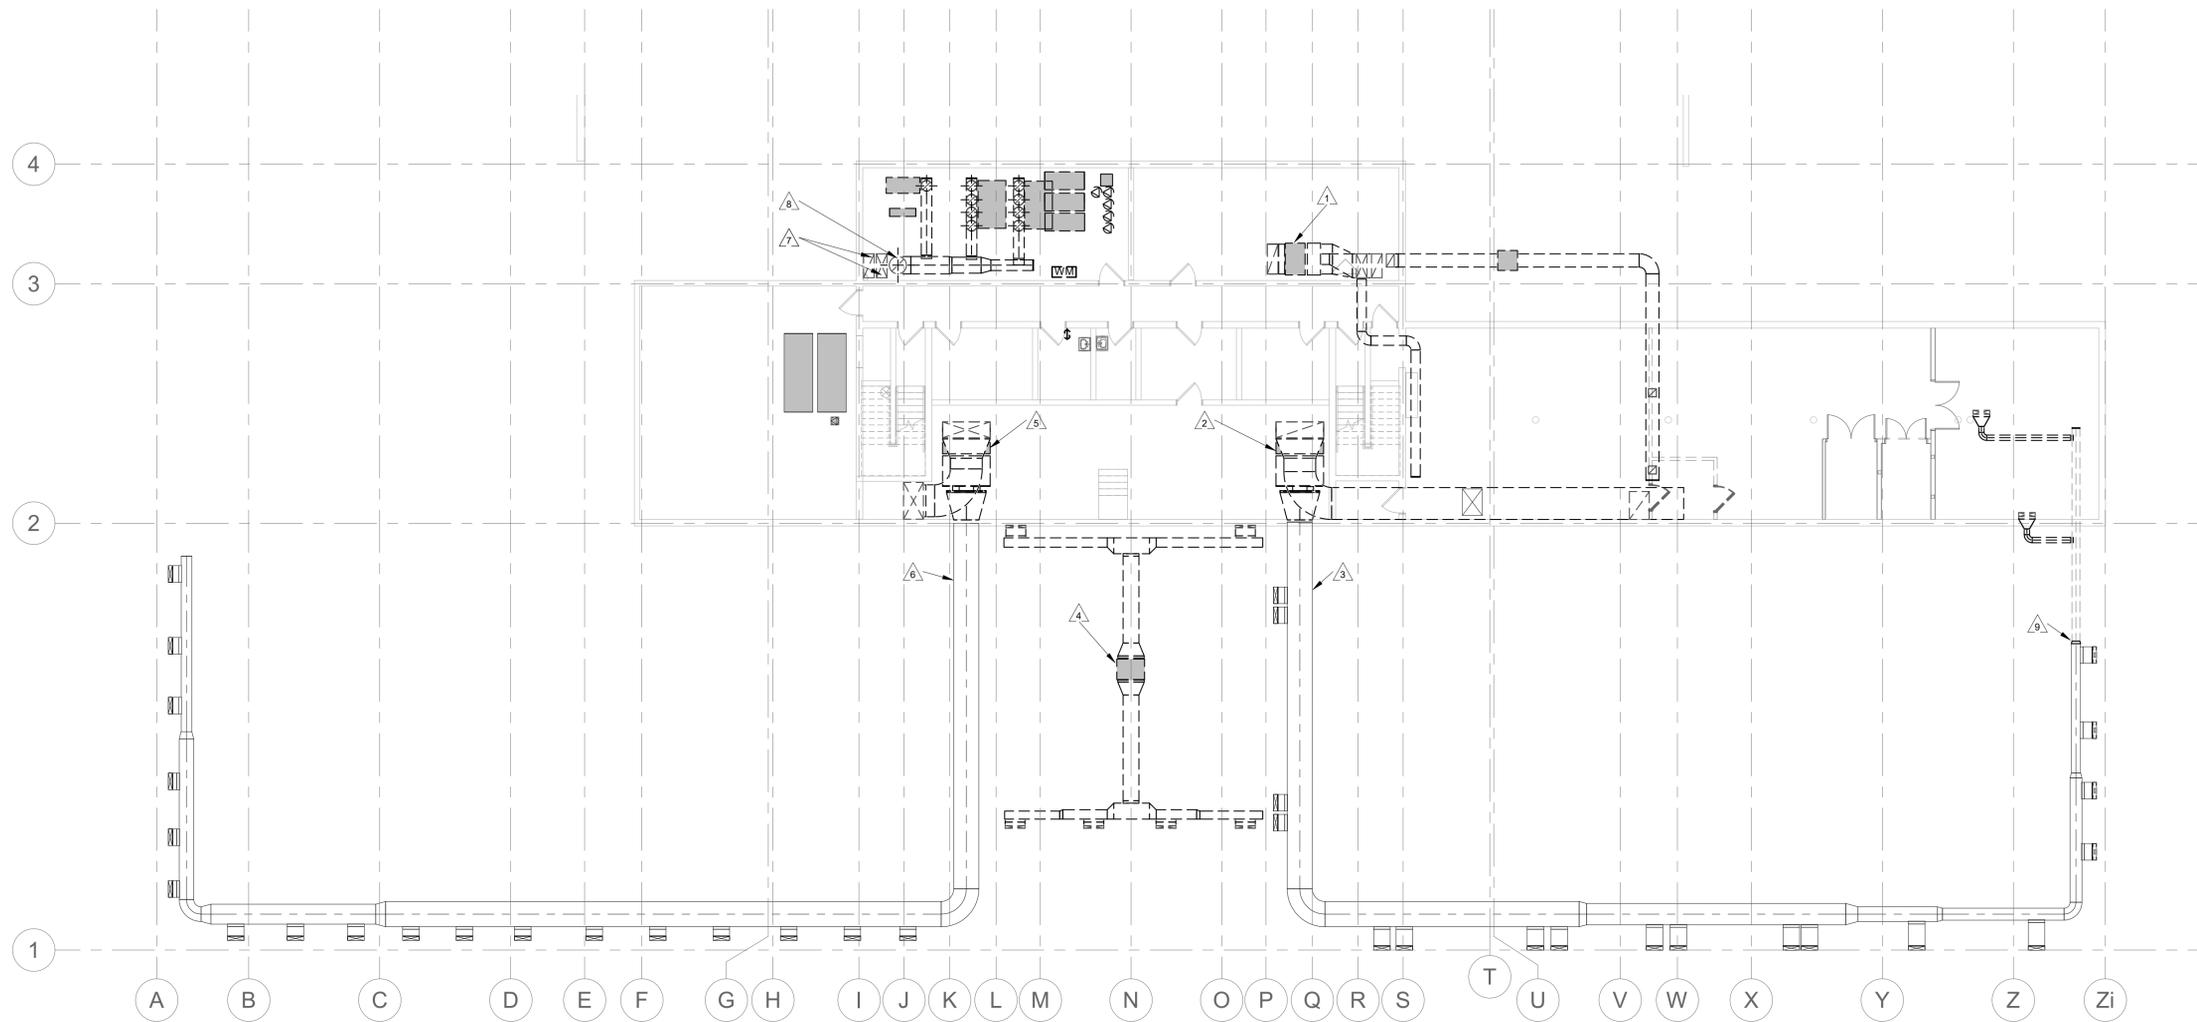

BASEMENT - HVAC DEMOLITION 1
 3/32" = 1'-0" MH2.0



This is a print of a document that has been electronically authenticated with technology authorized by the APEGM. The original is in electronic form.



This drawing must not be scaled. The contractors shall verify all dimensions and other data on site prior to commencement of work. Discrepancies, errors, and omissions are to be reported to Public City Architecture Inc. prior to proceeding with the Work.
 Drawings and specifications as instruments of service are the property of Public City Architecture Inc. the copyright in the same being reserved.
 No reproduction or revision to these drawings may be made without the permission of Public City Architecture Inc. and when made, must bear their name. All prints to be returned to Public City Architecture Inc. upon request.

Project
ST. JAMES CIVIC CENTRE

Drawing
BASEMENT DEMOLITION - HVAC PLAN

Drawn By:	GC	Review By:	JS
Scale:	3/32" = 1'-0"	Tender No:	1176-2019
Date:	11/06/19		
Sheet:			MH2.0