



1 | BASEMENT - HAZARDOUS LOCATION PLAN

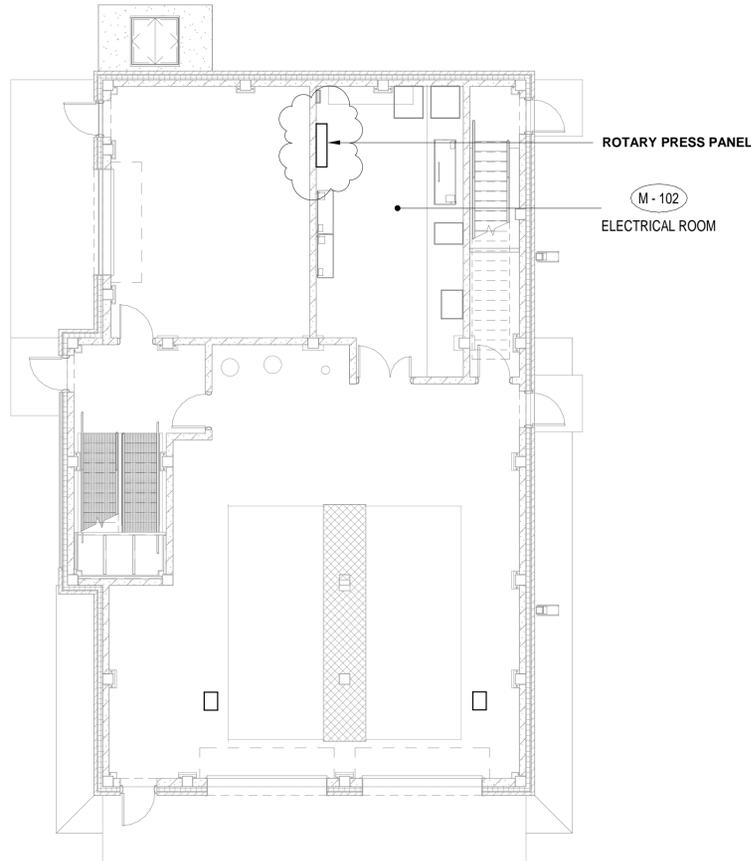


2 | MAIN LEVEL - HAZARDOUS LOCATION PLAN

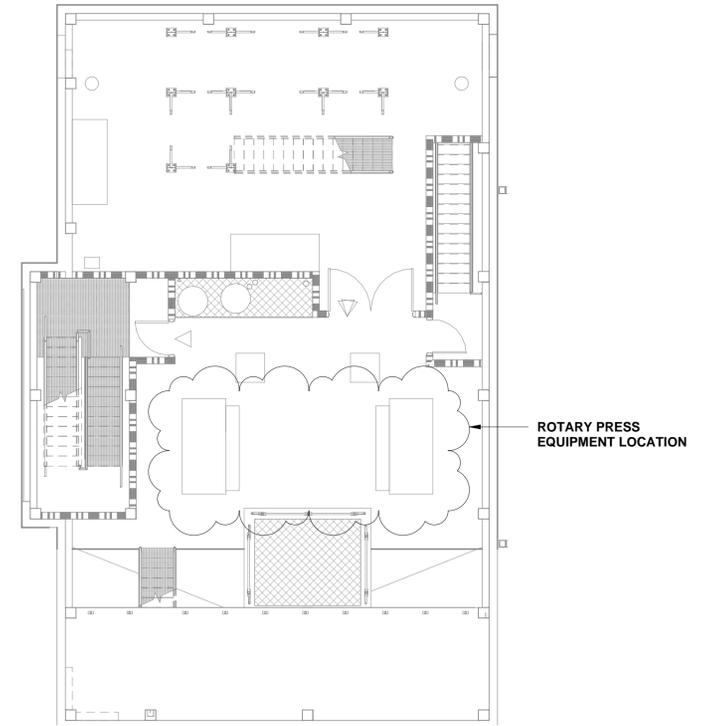

3 | SECOND LEVEL - HAZARDOUS LOCATION PLAN



LEGEND

-  ZONE 0
-  ZONE 1
-  ZONE 2
-  NON-HAZARDOUS

NOTES:

1. SCUM DEWATERING BUILDING IS NON-HAZARDOUS AS THE SPACE IS VENTILATED AT 12 ACH.

**DRAFT**

**FOR REFERENCE ONLY**



NO.	REVISIONS	DATE	DESIGN	CHECK
0	ISSUED FOR TENDER OF ROTARY PRESS SUPPLY	2022-12-15	KG	SDS

<b>AECOM</b>	
DESIGNED BY: KG	CHECKED BY: SDS
DRAWN BY: MM	APPROVED BY: NW
SCALE: As indicated	RELEASED FOR CONSTRUCTION BY:
DATE: 2021-06-07	DATE:
CONSULTANT NO.:	P3-E141A

ENGINEER'S SEAL  
**PRELIMINARY**  
**NOT TO BE USED FOR CONSTRUCTION**

TENDER NO.

**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT

NORTH END SEWAGE TREATMENT PLANT  
 REQUEST FOR PROPOSALS FOR SUPPLY OF ROTARY PRESS & APPURTENANCES  
 AUTOMATION  
 SCUM DEWATERING BUILDING - OVERALL  
 HAZARDOUS LOCATION PLAN

CITY DRAWING NUMBER	SHEET	REV.	SIZE
		0	A1