




PLUMBING/MECHANICAL ROOM PHOTOS

Supply and Install 125mm thick reinforced concrete pad on 150mm compacted granular base (refer to Detail 2) (3 SM)


Top of asphalt to be flush with water station pad and existing concrete pad

Supply and Install ELKAY OUTDOOR EZH2O water station. Install and secure to pad as per manufacturer's written instructions. Refer to Detail 1 for dimensions


Tie new slab into existing w/ 600mm long 10M dowels spaced 600mm o/c

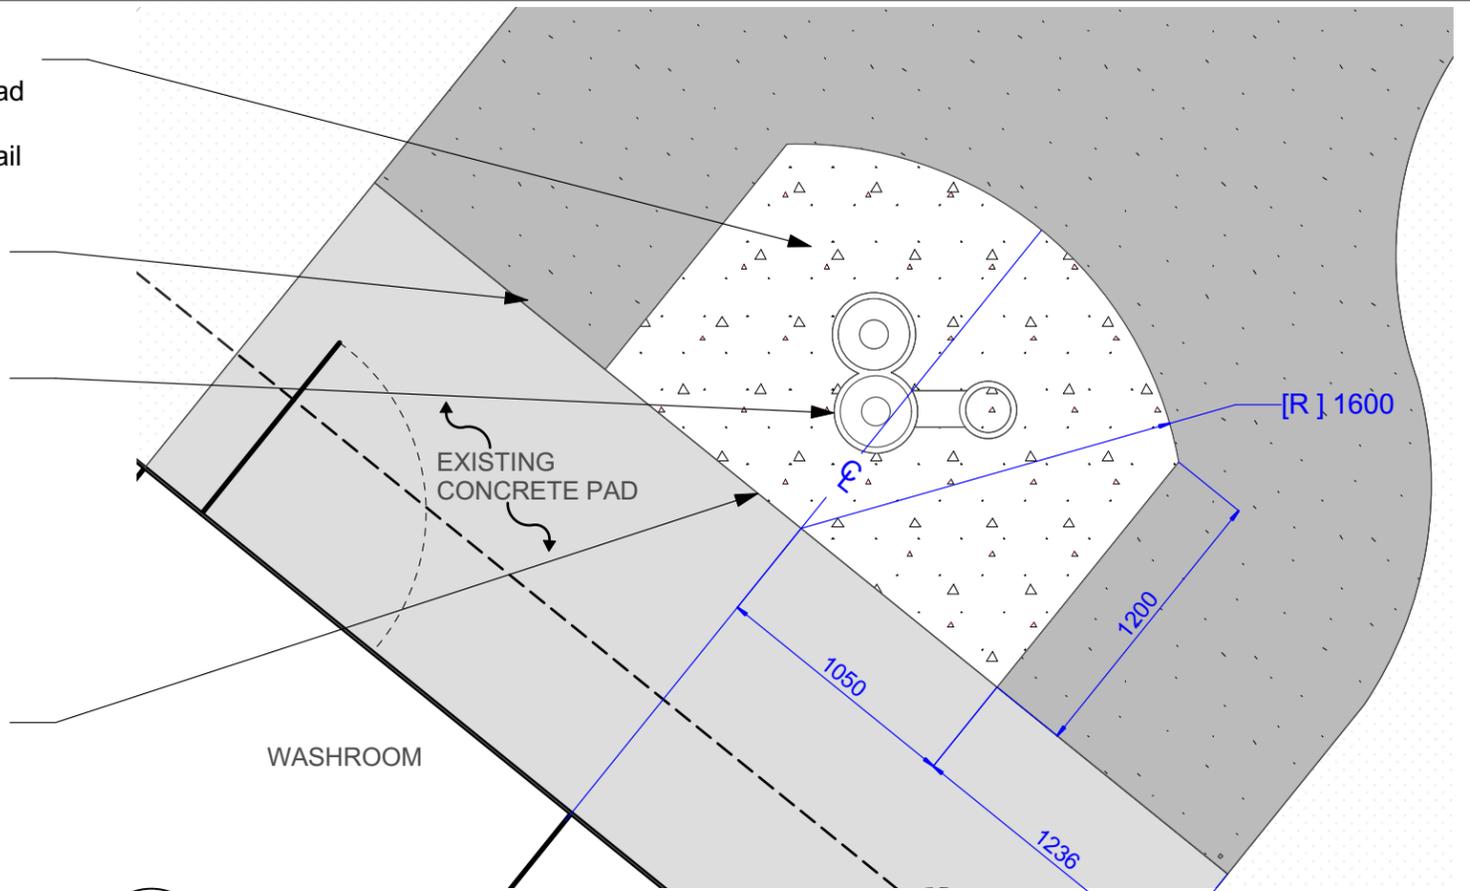

3 WATER STATION PAD LAYOUT
Scale: NTS

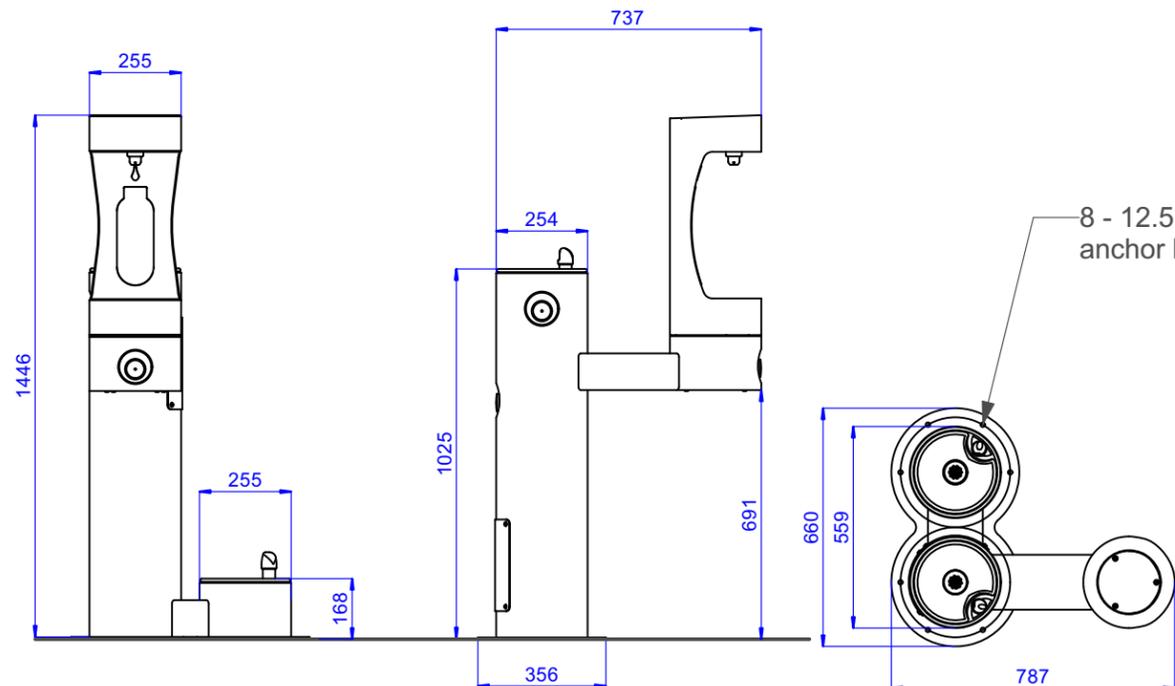

1 ELKAY OUTDOOR EZH2O
Scale: 1:20

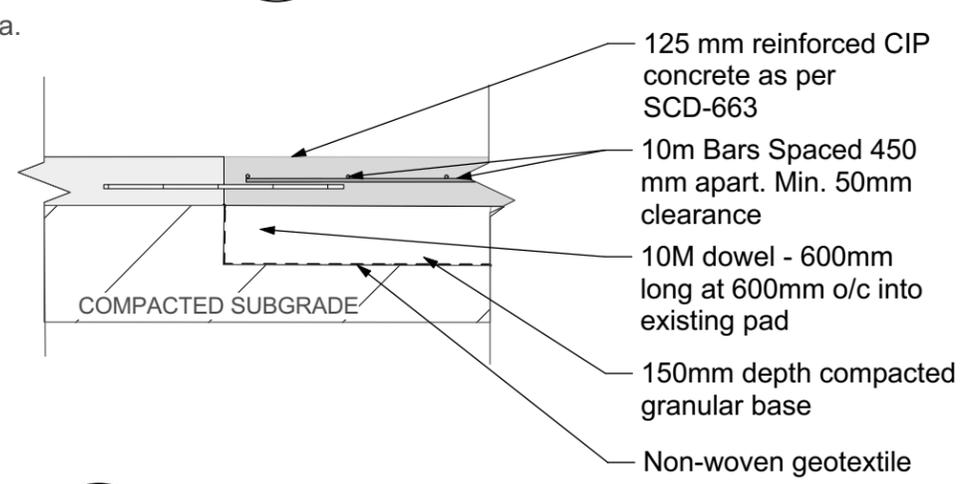

2 CIP PAD AND TIE-IN TO EXISTING
Scale: NTS

LAYOUT NOTES:
1. DIMENSIONS ARE IN MM
2. THE LAYOUT OF THE DRINKING WATER STATION CONCRETE PAD AND THE ASPHALT PATHWAY SHALL BE APPROVED BY CONTRACT ADMINISTRATOR PRIOR TO CONSTRUCTION

CONTRACTOR TO CONFIRM ALL DIMENSIONS AND REPORT ANY DISCREPANCIES TO CONTRACT ADMINISTRATOR PRIOR TO CONSTRUCTION. LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.



THE CITY OF WINNIPEG
Planning, Property and Development Department
Planning and Land Use Division
Unit 15 - 30 Fort Street, Winnipeg, MB, (R3C 4X5)

DESIGNED BY	RZ	CHECKED BY	RZ
DRAWN BY	IM	APPROVED BY	
HORIZ. SCALE	VARIES		
VERT. SCALE			
DATE	Oct 2022		

MANAGER, PARK AND OPEN SPACES	DATE
MANAGER, PLANNING AND LAND USE DIVISION	DATE

DRAWING TITLE
Bourkevale CC
Drinking Water Station
Layout and Details

SITE ADDRESS **100 Ferry Rd.**

DRAWING NO.
B.54 - C2

BID OPPORTUNITY NO.
727-2022