



NOTES:

1. RESURFACED GRANULAR PATHS TO HAVE TOP 75mm OF IN SITU MATERIAL STRIPPED, REPLACED WITH 50mm OF CRUSHED LIMESTONE BASE COURSE (20mm DN) AND SURFACED PER DETAIL
2. WHERE GRANULAR PATHS ABUT EXISTING GRANULAR SURFACES, LIMESTONE SURFACING TO TAPER 900mm INTO EXISTING TO MAKE CLEAN TRANSITION
3. WHERE GRANULAR PATH ABUT CONCRETE SPRAY BASIN, LIMESTONE SURFACING TO BE ≤ 5 mm BELOW ELEVATION OF BASIN

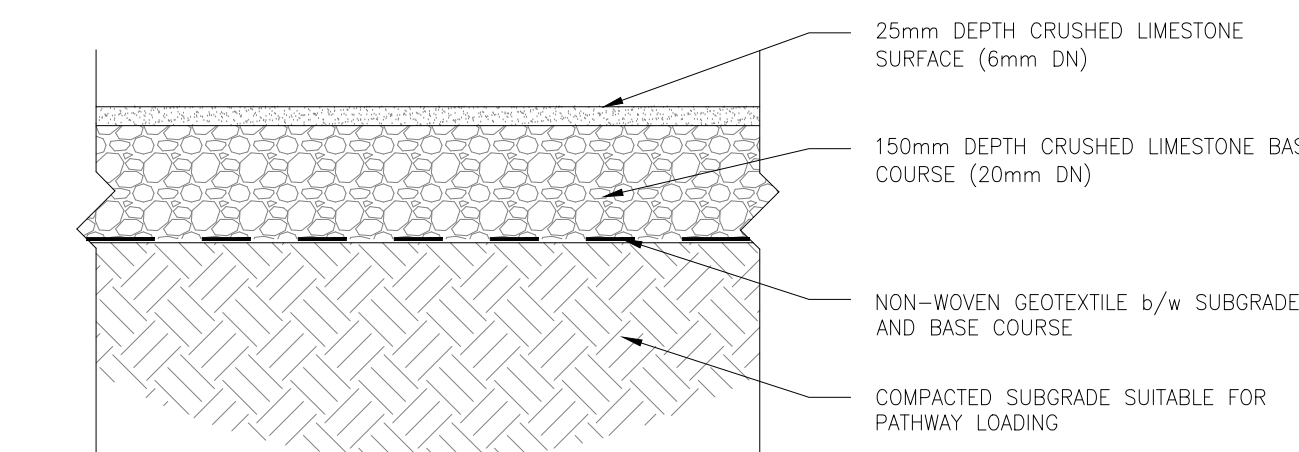


2 GRANULAR PATHWAY
L101 L400 1:10

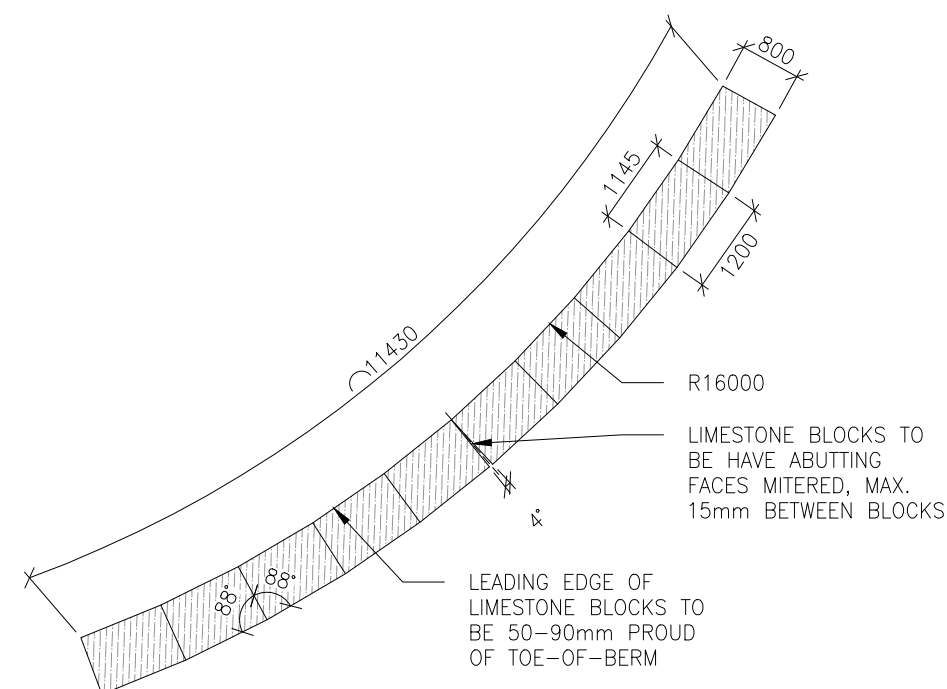


4 LIMESTONE BLOCK LAYOUT PLAN
01 L400 1:100

NOTES:

1. SEATING NODES TO RESPECT ALL CLEARANCE REQUIREMENTS PER SCD-136A
2. SHADE STRUCTURE TO BE INSTALLED PRIOR TO LAYING OUT SITE FURNISHINGS, MAINTAIN 3050mm CLEARANCE FROM FINISHED GRADE OF CONCRETE BASIN TO UNDERSIDE OF SHADE SAIL. CONSTRUCTION AND INSTALLATION PER MANUFACTURER'S SPECIFICATIONS
1. SHADE STRUCTURE CIP CONCRETE PILE TO BE ISOLATED FROM CONCRETE BASIN w/ ISOLATION JOINT AROUND PERIMETER CONFORMING TO ASTM STANDARD D1751
2. CIP CONCRETE PILE AND REINFORCEMENT TO BE STAMPED IN ENGLISH TO MEET MANUFACTURER'S SPECIFICATIONS
3. CONTRACTOR TO SUBMIT ENGINEER-STAMPED SHOP DRAWINGS FOR SHADE STRUCTURE INC. CIP CONCRETE PILE w/ REINFORCEMENT FOR APPROVAL PRIOR TO CONSTRUCTION
4. SITE FURNISHING TO BE SURFACE MOUNTED. REFER TO SPECIFICATIONS

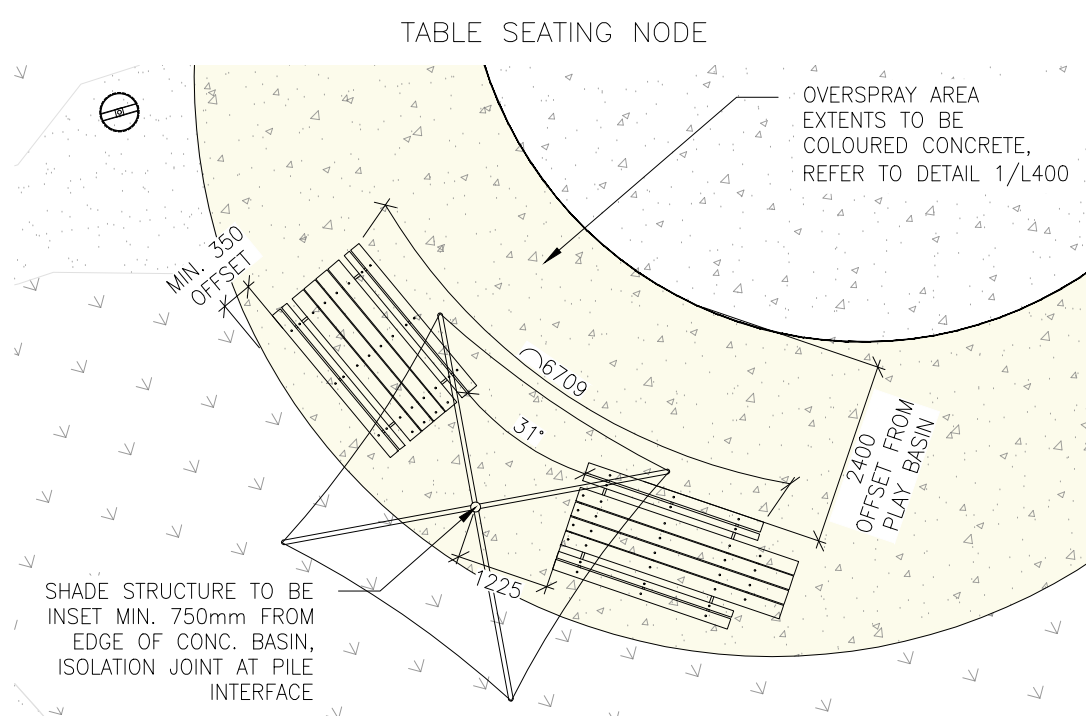


6 SHADE SAIL + SEATING NODE PLANS

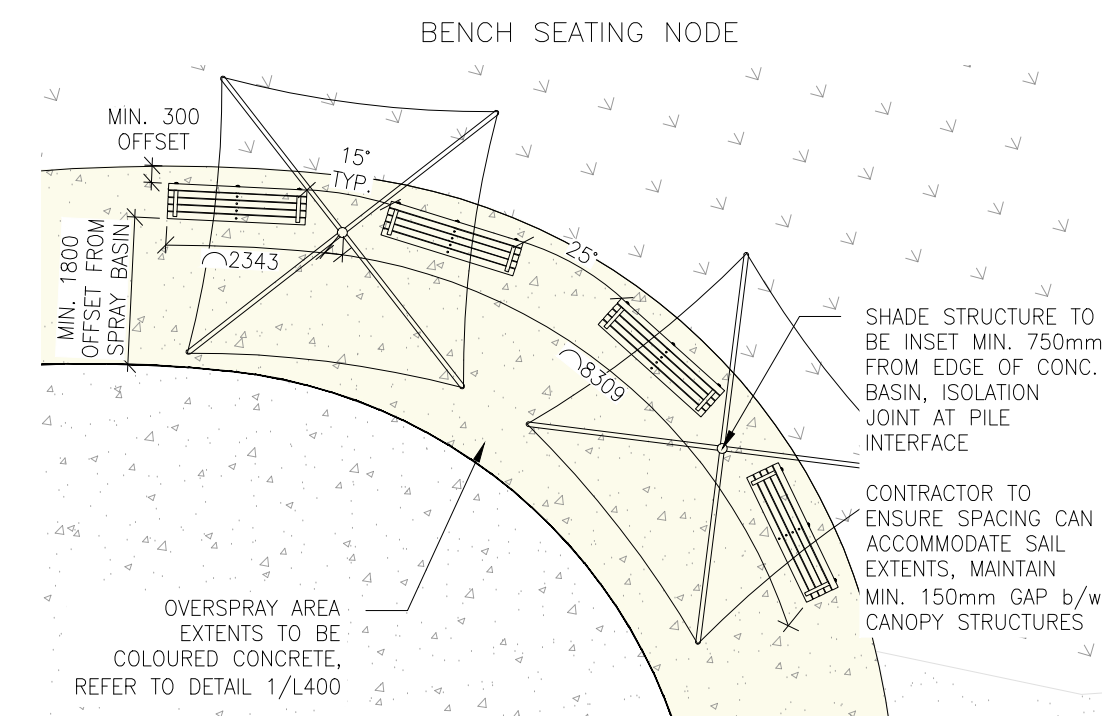


NOTES:

1. IF MINIMUM UTILITY SETBACKS PERMIT, POSITION TREE STAKES INTO DIRECTION OF PREVAILING WINDS
2. ALL TREE STAKES TO MAINTAIN MINIMUM 1.0m CLEARANCE FROM ALL U/G POWER, TELEPHONE AND GAS ALIGNMENTS
3. DIG ALL ROOT HOLES BY HAND WHEN CLOSER THAN 1.0m TO U/G POWER, TELEPHONE AND GAS ALIGNMENTS
4. TREE LOCATIONS TO BE STAKED FOR APPROVAL BY LANDSCAPE ARCHITECT PRIOR TO EXCAVATION

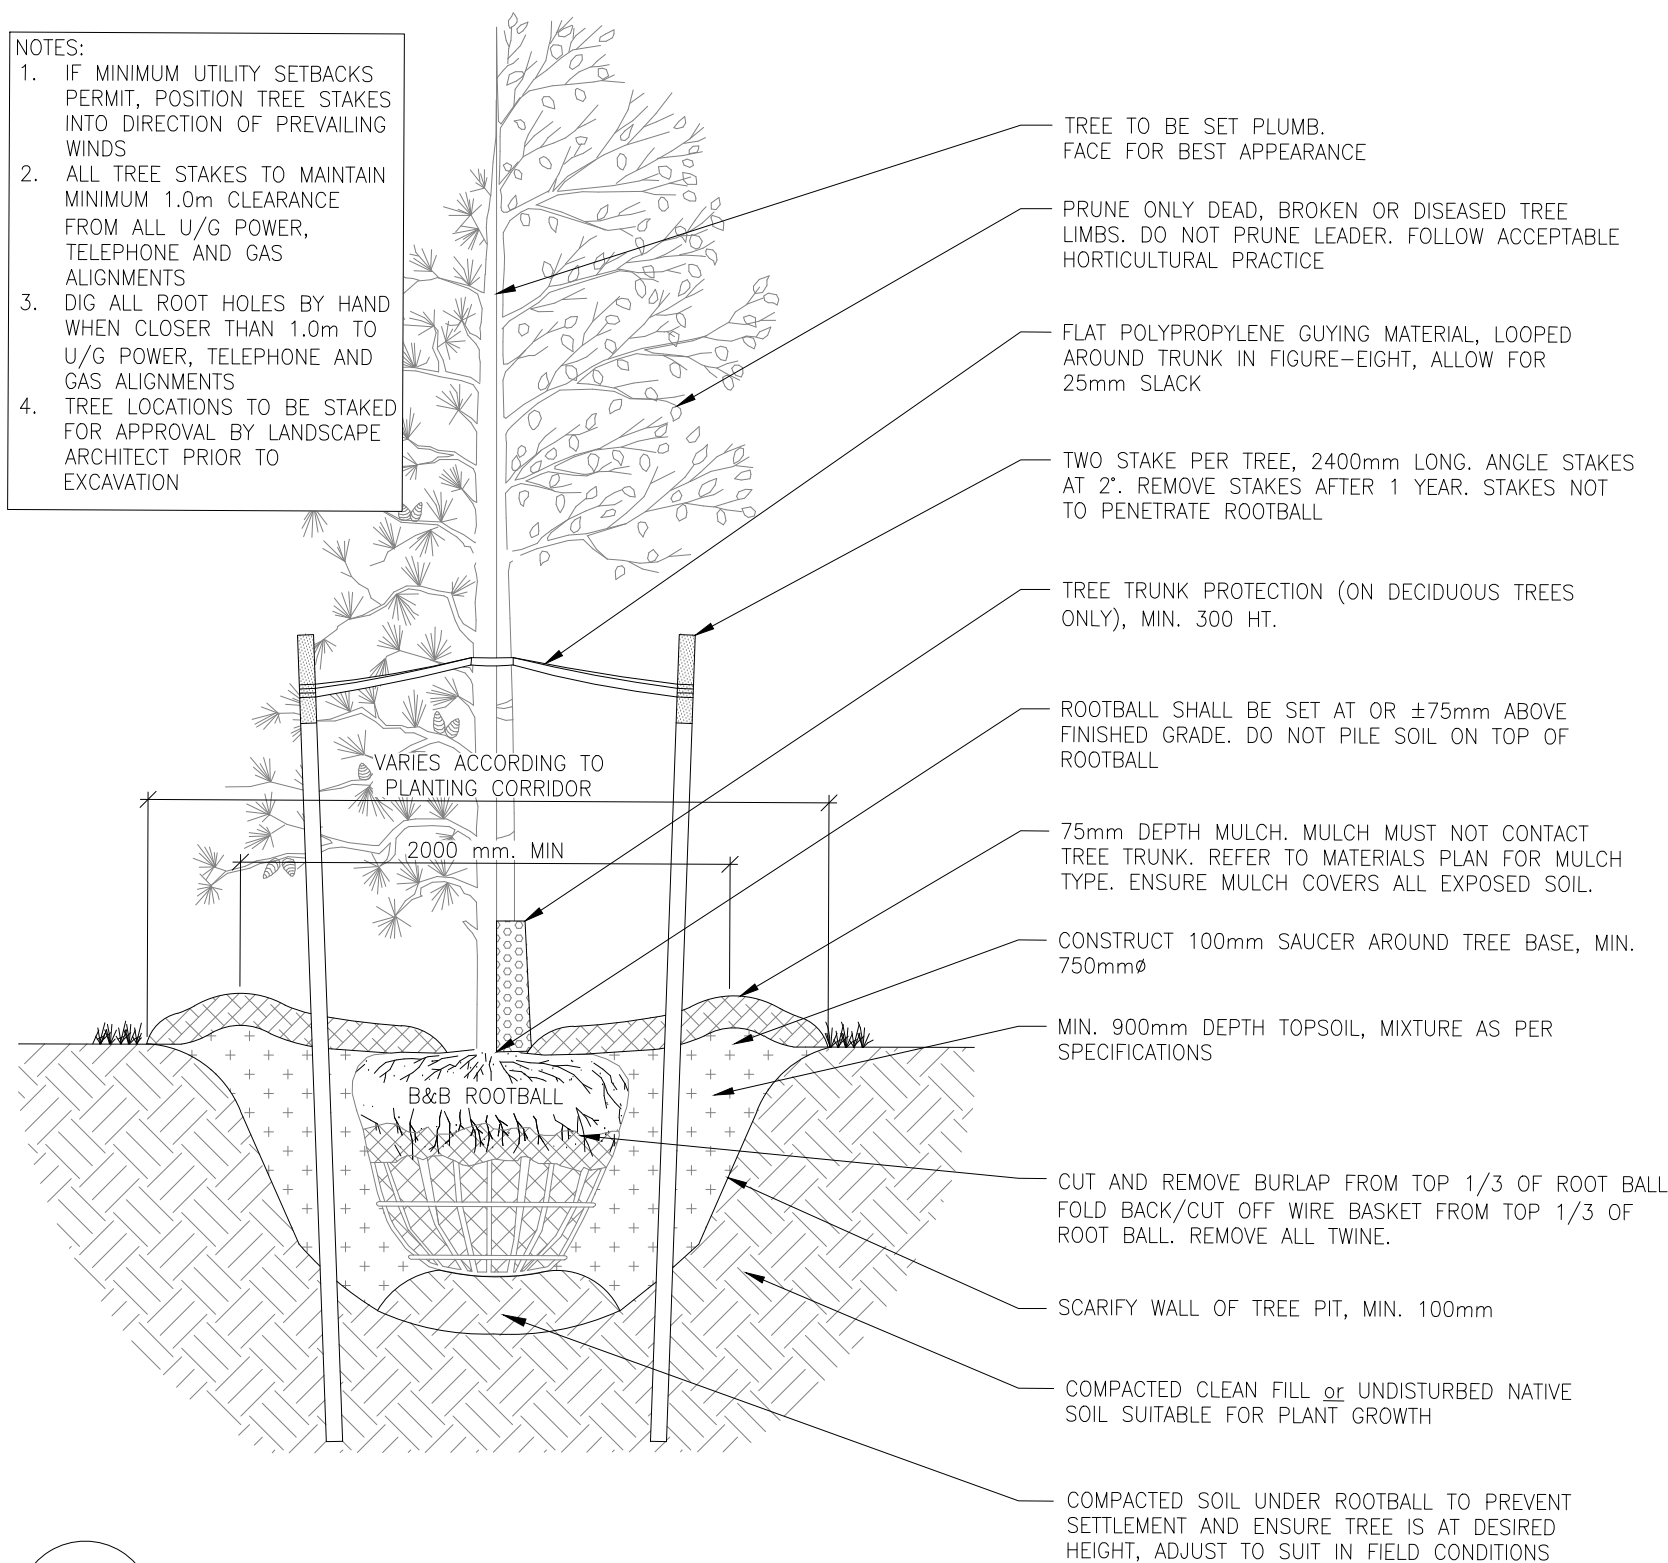


8 TREE PLANTING
L101 | L400 1:20

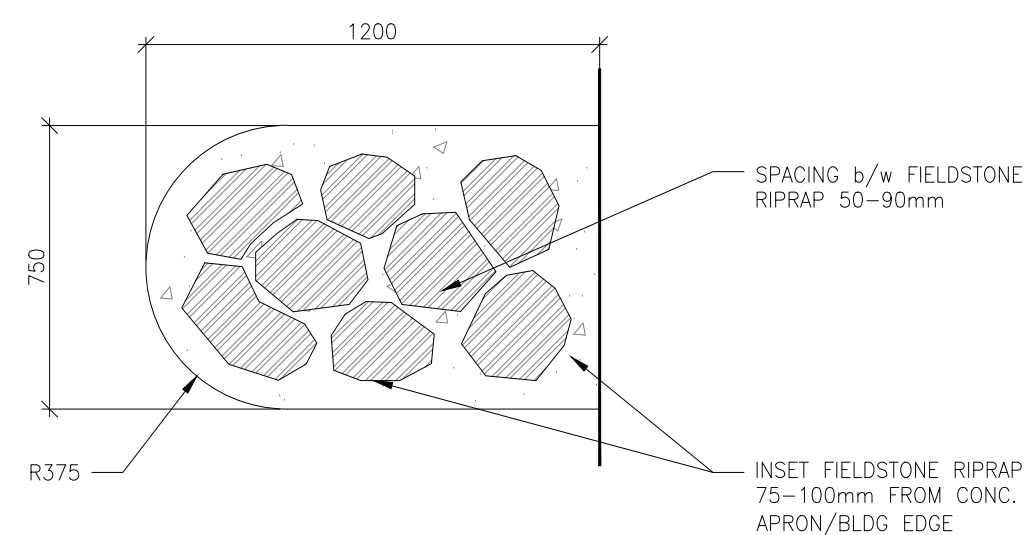

NOTES:

1. GROUTED RIPRAP PADS TO BE CENTERED ON EXISTING BUILDING RAINWATER LEADERS, SUMP PUMP DISCHARGE LOCATIONS
2. FIELDSTONE RIPRAP PER CW 3615
3. CONTRACTOR TO SUBMIT FIELDSTONE SAMPLES FOR APPROVAL PRIOR TO CONSTRUCTION

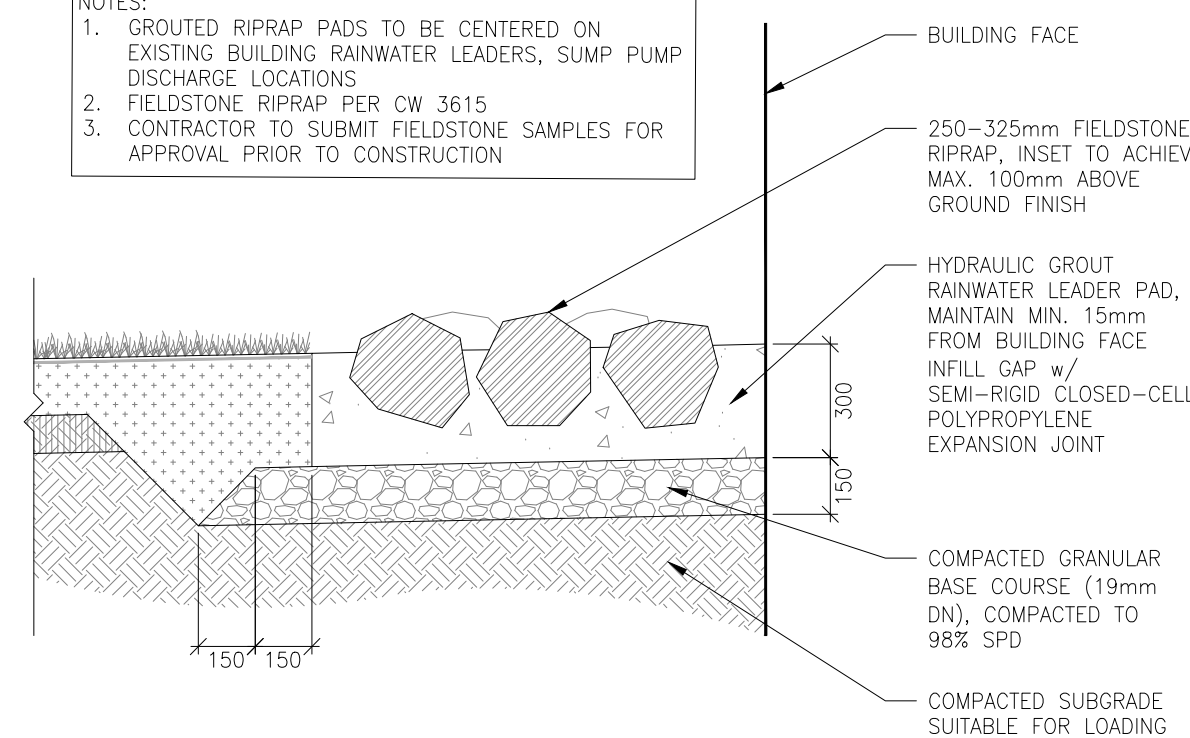

9 GROUTED RIPRAP
L101 | L400 1:20

NOTES:

1. PRUNE ALL BROKEN OR DEAD BRANCHES. FOLLOW THE MOST RECENT CANADIAN NURSERY & TRADES ASSOCIATION PRACTICE
2. PLANT PIT SHALL BE DUG TWICE DIAMETER OF THE ROOT BALL
3. POSITION SHRUBS FOR BEST APPEARANCE
4. STAGGER PLANTING SUCH THAT ALL PLANTS ARE EQUALLY SPACED FROM EACH OTHER AS SPECIFIED IN PLANT LIST
5. PLANTING BED TO BE CONTINUOUS, STAKE FOOTPRINT FOR APPROVAL BY LANDSCAPE

7 SHRUB PLANTING BED
L101 L400 1:20

BID OPP. NO. 663-2025