


TYPICAL RESIDENTIAL INSTALLATION

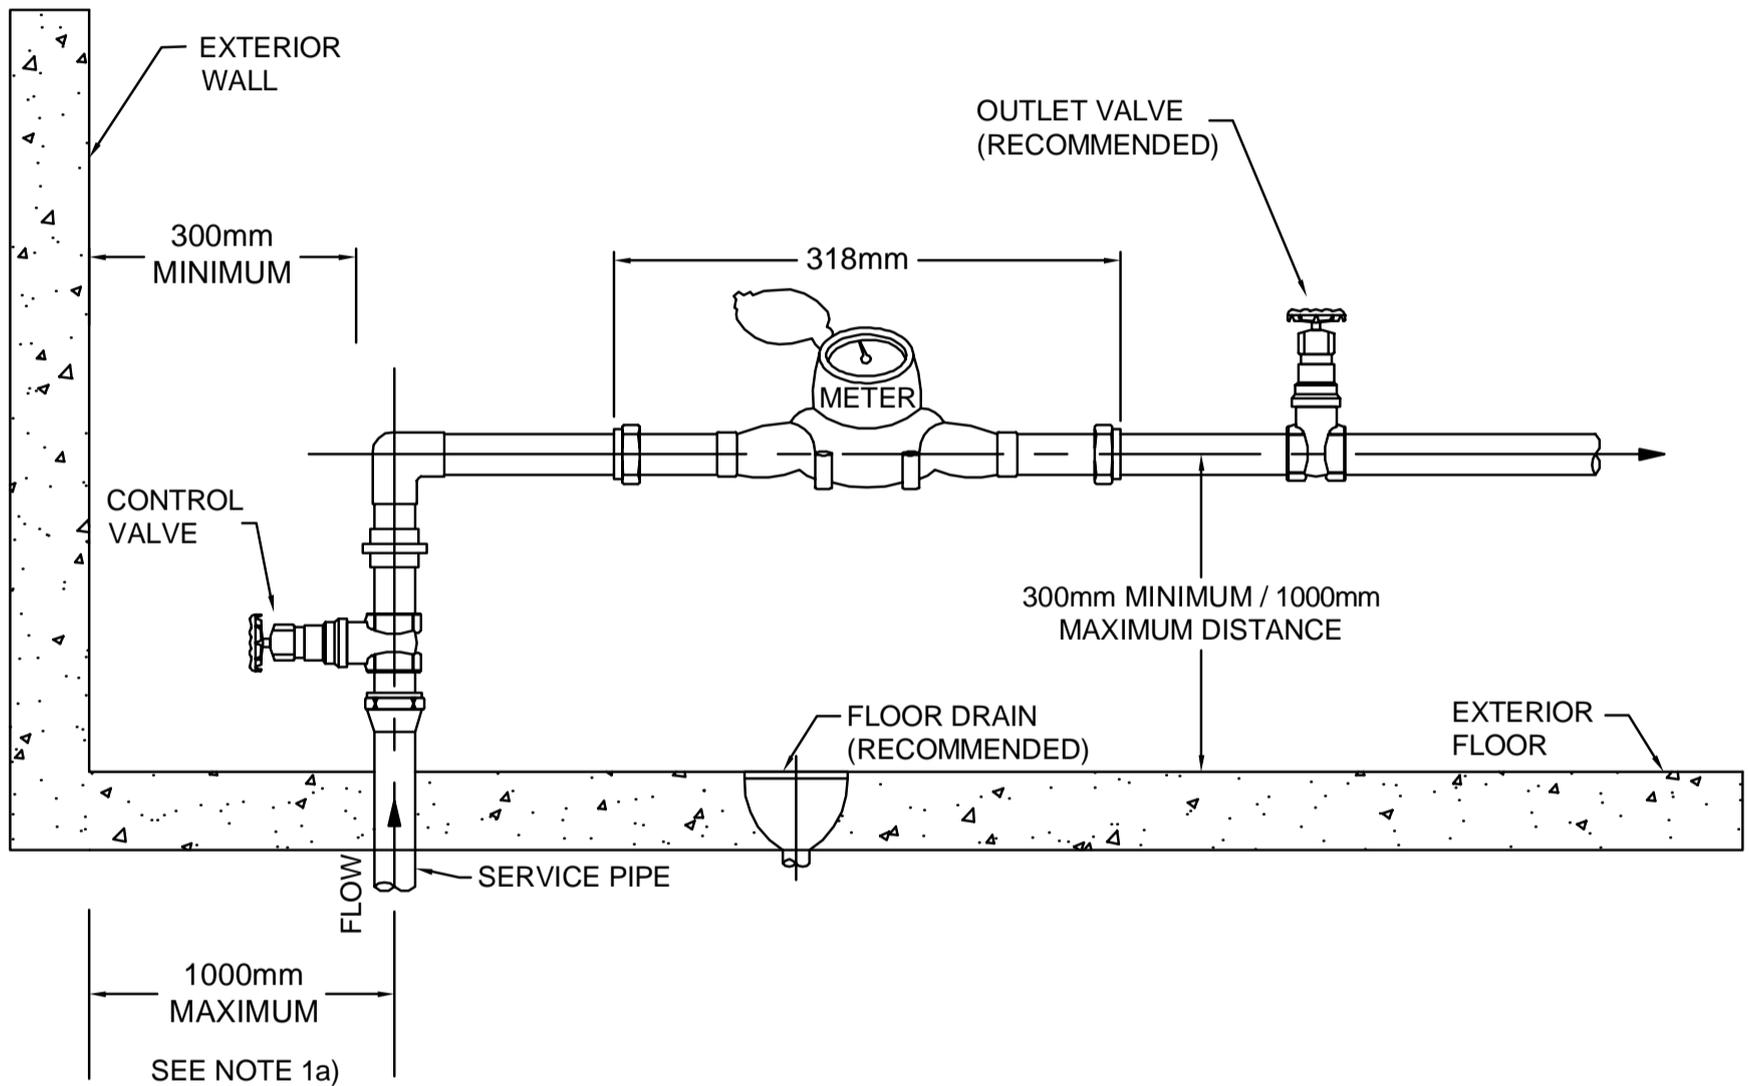

THE CITY OF WINNIPEG
WATER & WASTE DEPARTMENT

Reference Spec. No.

INSTALLATION DETAILS FOR
 POSITIVE DISPLACEMENT AND
 NON-MECHANICAL TYPE WATER METER
 IN BUILDINGS
 20mm DOMESTIC SERVICE PIPE

Designed By:
 JCE

Drawn By:
 TV

Scale:
 N.T.S.

Checked By:
 WATER BY-LAW
 COMMITTEE

Date: 2016-03-16
Revision: 9

Drawing No.

Approved:
 WATER BY-LAW COMMITTEE

SD-027A (1 of 2)

INSTALLATION DETAILS FOR POSITIVE DISPLACEMENT AND NON-MECHANICAL TYPE WATER METER IN BUILDINGS

METER SIZE	A (mm)
16mm (5/8")	318

NOTES:

- 1) THE SERVICE PIPE MUST ENTER A BUILDING A MINIMUM OF 300mm AND A MAXIMUM OF 1000mm FROM THE EXTERIOR WALL
- 1a) THE 1000mm MAXIMUM DISTANCE FROM THE EXTERIOR WALL IS EFFECTIVE:
 - MAY 1, 2018 FOR SINGLE FAMILY RESIDENTIAL BUILDINGS WITH A CONCRETE SLAB FOUNDATION (OR CONCRETE FLOOR)
 - JANUARY 1, 2016 FOR ALL OTHER BUILDINGS
- 2) PIPE SUPPORT / ANCHORING MUST BE PROVIDED TO MAINTAIN PIPE ALIGNMENT AND TO SUPPORT THE WEIGHT OF THE PIPE, METER AND RELATED COMPONENTS
- 3) METERS MUST BE INSTALLED IN A HORIZONTAL POSITION
- 4) COPPER TO FEMALE IRON PIPE THREAD ADAPTORS MUST BE SUPPLIED TO ACCOMMODATE METER TAILPIECES
- 5) THE CONTROL AND OUTLET VALVE MUST BE FULL PORT GATE OR BALL VALVES
- 6) NO CONNECTIONS ARE PERMITTED UPSTREAM OF THE WATER METER
- 7) WATER METERS MUST NOT BE INSTALLED IN CONFINED SPACES (EG. CRAWL SPACES). WHERE A SERVICE PIPE ENTERS A CONFINED SPACE THE WATER METER MUST BE INSTALLED IN THE IMMEDIATE ADJACENT SPACE INTENDED FOR CONTINUOUS OCCUPANCY. ALL WATER SERVICE PIPE ENTERING THE BUILDING TO THE WATER METER MUST BE CLEARLY VISIBLE FROM THE WATER METER WITHOUT ENTRY TO THE CONFINED SPACE (EG. ACCESS DOOR)

RECOMMENDATIONS:

- 1) OUTLET VALVE
- 2) METER TO BE INSTALLED IN CLOSE PROXIMITY TO FLOOR DRAIN ON AN UNFINISHED FLOOR
- 3) PROVIDING UNOBSTRUCTED SPACE OF 1000mm WIDE BY 1000mm DEEP BY 2000mm HIGH, CENTERED IN FRONT OF THE WATER METER, WILL BE DEEMED COMPLIANT WITH THE ACCESS REQUIREMENTS OF THE WATER BY-LAW



THE CITY OF WINNIPEG
WATER & WASTE DEPARTMENT

Reference Spec. No.

INSTALLATION DETAILS FOR
POSITIVE DISPLACEMENT AND
NON-MECHANICAL TYPE WATER METER
IN BUILDINGS
20mm DOMESTIC SERVICE PIPE

Designed By:
JCE

Checked By:
WATER BY-LAW
COMMITTEE

Approved:
WATER BY-LAW COMMITTEE

Drawn By:
TV

Date: 2016-04-13
Revision: 10

Scale:
N.T.S.

Drawing No.
SD-027A (2 of 2)